2018 IRC - IBC

2006 **IECC** 

**CALL TWO WORKING DAYS BEFORE YOU DIG** 

1-800-STAKE-IT (1-800-782-5348) YAVAPAI COUNTY

2018 IRC R311.3 There shall be a floor or landing on each side of the exterior door. The width of the landing shall not be less than the door served with a minimum distance of 36" measured in the direction traveled.

The inspector may require further clarification on stamped plans. This may include, but not limited to a special inspection and /or a cross section detail stamped and signed by the Designer/Architect/Engineer of record.

# YAVAPAI DEVELOPMENT SERVICES \*PARCEL

\*OWNER/APPLICANT PERMIT #: PROJECT: **HOME OF MY OWN - 3 BED RIGHT (2024 PLANS)** 

\* Information required to be filled out by the applicant.

Yavapai County Ordinance, Section 112.6 **Drainage across Property Lines.** 

**CAUTION** 

Yavapai County permitted building plans do not relieve

the Owners or General Contractor from their

responsibilities to conform to all adopted building codes.

Every effort has been made to provide a thorough plan

review, however plans may contain irregularities. If plans

do not contain the proper information or details the

Owner/General Contractor Shall Not proceed with the

project until the issue has been resolved through Yavapai

County and any professional involved in the project

Drainage across property lines shall not exceed that which existed prior to grading. Excess or concentrated drainage shall be contained on site or directed to an approved drainage facility. Erosion of the ground in the area of discharge shall be prevented by installation of non-erosive down-drains or

other devices.

IBC 406.3.3: Garage/ carport surfaces used for parking of vehicles shall be sloped to drain liquids to the main vehicle entry doorway or an approved drain

Per 2018 IRCR309.1, R309.2, and

Effective April 20, 2006, **Fully shielded fixtures are** required for all exterior lamps

Per Article 210.12 of the

are required

A separate permit for alternative

electric source is required. The

alternative electric source

permit will need to be issued

and finalized before a building

final can be obtained

The mechanical equipment, design and system have been reviewed for the basic design ONLY. The HVAC contractor shall review the plans/ calculations to assure the design is adequate and complies with all applicable codes and installation

THE ENGINEERED **GEOTECHNICAL REPORT IS A** PART OF THE PERMITTED **DOCUMENTS, AND SHALL BE** 

**ONSITE AT ALL TIMES WITH THE** 

PERMITTED PLANS.

Applicant acknowledges that plans stamped by a

registrant will not be fully reviewed by staff and

that approvals are contingent upon favorable

field inspections. Should conditions in the field

prove non-conducive to code requirements,

significant delays may be realized. Applicant

attests that the sealed plans are in compliance

with all applicable codes and ordinances

**2017 NEC** Arc fault circuit interupters

THE GAS PIPING INSTALLER SHALL **VERIFY THE SYSTEM IS OF SUCH SIZE** FOR THE MAXIMUM DEMAND AND TO **MEET EACH APPLIANCE INLET AT NOT** LESS THAN THE MINIMUM SUPPLY PRESSURE REQUIRED

Foam spray shall comply with the ES Reports

and applicable codes. It is the responsibility

of the owner and/or contractor(s) to review

reports and understand requirements before

application, Ignition/thermal barrier is

required unless otherwise exempt. Failure to

comply may cause additional cost to the

owner/contractor(s).

THIRD PARTY SPECIAL INSPECTIONS REQUIRED: (Third party special inspections are not in lieu of required building inspections.) YES

The following items require special inspections:

- SOILS CONDITION
- SOILS COMPACTION
- BOTTOM OF FOOTING COMPACTION
- AND OTHER INSPECTIONS REQUIRED BY THE GEOTECHNICAL ENGINEER.

Reports to be supplied to the Building Inspector

It is imperative that the owner /contractor print ALL permit documents from the online portal before inspection.

#### **CAUTION:**

**Areas within Yavapai County are likely to** have expansive, compressible, shifting or other unknown soils conditions. The building official may require a soils test to determine the soils characteristic at a particular location.

**GENERAL GRADING NOTES:** 

Where the lot line walls, slopes, or other physical barriers prohibit 6" of fall within 10', drains or swales shall be provided to insure drainage away from the structure. **MAINTAIN MINIMUM 2:1 SLOPE** 

The faces of cut and fill slopes shall be prepared and maintained to control against erosion. The protection for the slopes shall be installed as soon as practicable and prior to requesting final approval. NO GRADING WITHIN 2' OF PROPERTY LINES

aps

Contact APS BEFORE you start construction; APS Prescott Office: 928-443-6797; Prescottcontroldesk@apsc.com APS Cottonwood Office: 928-646-8502; Verdecontroldesk@apsc.com

APS Wickenburg Office: 602-371-6200; Wickenburg controldesk@apsc.co

The property owner shall be responsible to verify fire sprinkler requirements with the governing fire district

Provide at least one window or exterior door approved for emergency escape or rescue for every room used for sleeping purposes. 2018 IRC R310.1

**IMPORTANT!** Interconnected smoke detectors Footings will not be are required for this project per **2018 IRC R314.3.1. Each sleeping** room, outside each sleeping room and on each floor level.

**APPROVAL IS SUBJECT** TO FIELD INSPECTION AND COMPLIANCE WITH **ALL RELEVANT CODES,** LAWS AND ORDINANCES

**RAIN GUTTERS & DOWNSPOUTS** ARE REQUIRED

Positive drainage away from the structure is required. Refer to the geotechnical report for an additional requirements

inspected until the property corners are properly pinned. flagged and easily identifiable to the building inspector.

> Slab insulation shall be approved for the under slab application. Provide an ES Report and manufacturer's specifications if not using the pre-approved products

- 1. Extruded polystyrene insulation Dow
- 2. Extruded polystyrene Owen corning

Per 2018 YCABC Ordinance

**Pre-slab inspections are required** 

2014-1 Section 110.3.4:

No slab grade or floor framing

inspections will be conducted

without compaction reports.

square edge (Blue)

Foamular 250 (Pink)

**Reviewed for** Design Criteria Only

**/** 

Truss calculations to be on site at the time of frame inspection

BIG STAMP

#### BOARD OF SUPERVISORS

CRAIG BROWN, CHAIRMAN - DISTRICT 4

HARRY B. OBERG, MEMBER - DISTRICT 1

JAMES GREGORY, MEMBER - DISTRICT 2

MARY MALLORY, MEMBER - DISTRICT 5



# DEVELOPMENT SERVICES

JEREMY DYE, DIRECTOR MARK LUSSON, ASSISTANT DIRECTOR WARREN COLVIN, CHIEF BUILDING OFFICIAL

na only. Contractor shall carefully review o

COVER BDRM / 3 4

**ARIZ** 

S

SHEET NO:

DONNA G. MICHAELS, Ph.D., VICE CHAIR - DISTRICT 3

HOME OF MY OWN Phase Two

THREE BEDROOM / TWO BATH - RIGHT PARKING

Single-Family Housing

# YAVAPAI COUNTY, ARIZONA 1015 Fair Street Prescott, Arizona

# INDEX TO DRAWINGS

**ELECTRICAL** 

M-1.1

E-1.0

l CS	COVER SHEET W/ PROJECT INFORMATION
A-1.0	FLOOR PLAN / OPENING SCHEDULES (Garage option)
A-1.1	FLOOR PLAN / OPENING SCHEDULES (Carport option)
A-2.0	FOUNDATION PLANS
A-3.0	ROOF FRAMING PLAN (Garage option)
A-3.1	ROOF FRAMING PLAN (Carport option)
A-4.0	BRACE WALL PLAN/CALCULATIONS (Garage option)
A-4.1	BRACE WALL PLAN/CALCULATIONS (Carport option)
A-5.0	EXTERIOR ELEVATIONS
A-6.0	BUILDING SECTIONS
A-7.0	DETAILS
M-1.0	MECHANICAL (FAU ABOVE HABITABLE AREA)

MECHANICAL (FAU ABOVE GARAGE/CARPORT)

# PROJECT INFORMATION

ALL WORK SHALL CONFORM TO ALL YAVAPAI COUNTY ADOPTED CODES, ORDINANCES AND POLICIES, INCLUDING BUT NOT LIMITED TO THE FOLLOWING 2018 INTERNATIONAL RESIDENTIAL CODE (IRC) 2018 INTERNATIONAL PLUMBING CODE (IPC) 2018 INTERNATIONAL MECHANICAL CODE (IMC) 2017 NATIONAL ELECTRIC CODE (NEC)

2006 INTERNATIONAL ENERGY CONSERVATION CODE (IECC)

LIVABLE: 1,613 SQ. FT. CARPORT/ALT. GARAGE: 483 SQ. FT. 164 SQ. FT. COVERED ENTRY: COVERED PATIO: 113 SQ. FT. **TOTAL UNDER ROOF:** 2,373 SQ. FT

OCCUPANCY: R-3 (Single-Family Residential) CONSTRUCTION TYPE: V-B

THESE HOMES WERE DESIGNED FOR A MAXIMUM ELEVATION OF 6200 FEET (40 LB. SNOW LOAD). THEY WERE NOT DESIGNED FOR A TILE ROOF

#### GENERAL NOTES

1. DUE TO REPROGRAPHIC PROCESS, THESE PLANS MAY NOT BE ACCURATE TO SCALE. DIMENSIONS ARE NOT TO BE SCALED FROM THE WORKING DRAWINGS.

2. BEFORE ORDERING ANY MATERIALS OR STARTING ANY WORK, CONTRACTORS SHALL VERIFY ALL MEASUREMENTS AND EXISTING CONDITIONS AT THE SITE AND SHALL BE RESPONSIBLE FOR THE CORRECTNESS OF THE SAME. ANY DEVIATION AND/OR UNSAFE OR UNREGULATED CONDITIONS SHALL BE BROUGHT TO THE ATTENTION OF YAVAPAI COUNTY DEVELOPMENT SERVICES.

3. GENERAL CONTRACTOR TO VERIFY AND LOCATE ALL UTILITY STUB OUTS AND MAINS BEFORE BEGINNING CONSTRUCTION OF PROJECT.

4. GENERAL CONTRACTOR TO VERIFY THE REMOVAL AND/OR REPLANTING OF LANDSCAPE IF THE CONDITION OCCURS OVER THE PROJECT SITE.

5. DAMAGE TO SITE, UTILITIES, OR NEWLY BUILT IMPROVEMENTS, NOT DESIGNED FOR REMOVAL, SHALL BE THE RESPONSIBLITY OF THE GENERAL CONTRACTOR INVOLVED, AND SHALL BE REPAIRED OR REPLACED AT THE EXPENSE OF THE SAME.

6. VERIFY UNIFORMITY OF ALL FRAMING SO AS TO CREATE A SMOOTH, REGULAR FINISH WITH NO IRREGULARITIES.

1. IT IS THE RESPONSIBILTY OF THE GENRAL CONTRACTOR, TO THOROUGHLY REVIEW THE PLANS AND TO NOTIFY YAVAPAI COUNTY DEVELOPMENT SERVICES OF ANY DISCREPANCIES. YAVAPAI COUNTY, NOR THE ARCHITECT-OF-RECORD, WILL NOT BE RESPONSIBLE FOR MATERIALS IMPROPERLY ORDERED OR INSTALLED.

8. FAILURE BY THE GENERAL CONTRACTOR, OR SUB-CONTRACTORS, TO AQUAINT THEM-SELVES WITH ALL AVAILABLE INFORMATION CONCERNING THIS PROJECT SHALL NOT RELIEVE THEM OF THE RESPONSIBILITY TO PERFORM THEIR JORK PROPERLY.

9. APPROVAL OF ALL CONSTRUCTION IS SUBJECT TO FIELD VERIFICATION BY YAYAPAI COUNTY PERSONELL.

10. EVERY SLEEPING ROOM SHALL HAVE AT LEAST ONE (1) OPERATING WINDOW, OR DOOR, FOR EMERGENCY EGRESS, OPEN DIRECTLY TO A STREET, ALLEY, OR YARD.

SEE ATTACHED COVER SHEET FOR ALL STAMPS. IT IS THE RESPONSIBILITY OF THE OWNER/APPLICANT TO REVIEW AND ACKNOWLEDGE APPLICABLE STAMPS.

#### DOOR SCHEDULE

DR.	SIZE			DOOR TYPE	
#	W.	H.	T.	DOOKTITE	REMARKS
101	3'-0"	6'-8"	1-3/4"	SOLID-CORE WOOD	
102	2'-6"	6'-8"	1-3/4"	SOLID-CORE WOOD	IF USING GAS WATER HEATER, PROVIDE 12" X 12" VENTS, ONE AT THE TOP, AND BOTTOM OF DOOR
103	3'-0"	6'-8"	1-3/4"	SOLID-CORE WOOD	SELF-CLOSING HINGES AND SELF-LATCHING HARDWARE
104	2'-8"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
105	2'-4"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
106	2'-4"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
107	2'-4"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
108	6'-0"	6'-8"	-	SLIDING GLASS PATIO DOOR	
109	2'-6"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
110	2'-6"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
111	2'-4"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
112	2'-4"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
113	2'-6"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
114	2'-4"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
115	2'-4"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
116	2'-0"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
117	16'-0"	7'-0"	-	OVERHEAD GARAGE DOOR	
118	3'-0"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	

NOTE: WHEN USING DOOR #2 WITH THE ALTERNATE CARPORT, SELF-CLOSING & SELF-LATCHING ARE NOT REQUIRED.


# WINDOW SCHEDULE (8' plate height)

			<u> </u>
WIN.	SIZE	TYPE	REMARKS
Α	4040	ХО	EGRESS AT BEDROOM
В	3030	ХО	
С	3010	XO	
D	2030	SINGLE-HUNG	

WINDOW SCHEDULE (9' plate height)

		•	<u> </u>
WIN.	SIZE	TYPE	REMARKS
Α	4050	ХО	EGRESS AT BEDROOM MUST HAVE MAX. 44" SILL HEIGHT ABOVE FLOOR
В	3030	ХО	
С	3010	ХО	
D	2030	SINGLE-HUNG	

NOTE: FENESTRATION IN ZONE 2 (ELEVATIONS BELOW 3500 FT.) SHALL HAVE A MAXIMUM U-FACTOR OF 0.75, AND A MAXIMUM FENESTRATION SHGC FACTOR OF 0.40. FENESTRATION IN ZONE 4 (ELEVATIONS 3500 FT. AND ABOVE) SHALL HAVE A MAXIMU U-FACTOR OF 0.40. THE SHGC FACTOR IN ZONE 4 IS NOT APPLICABLE.

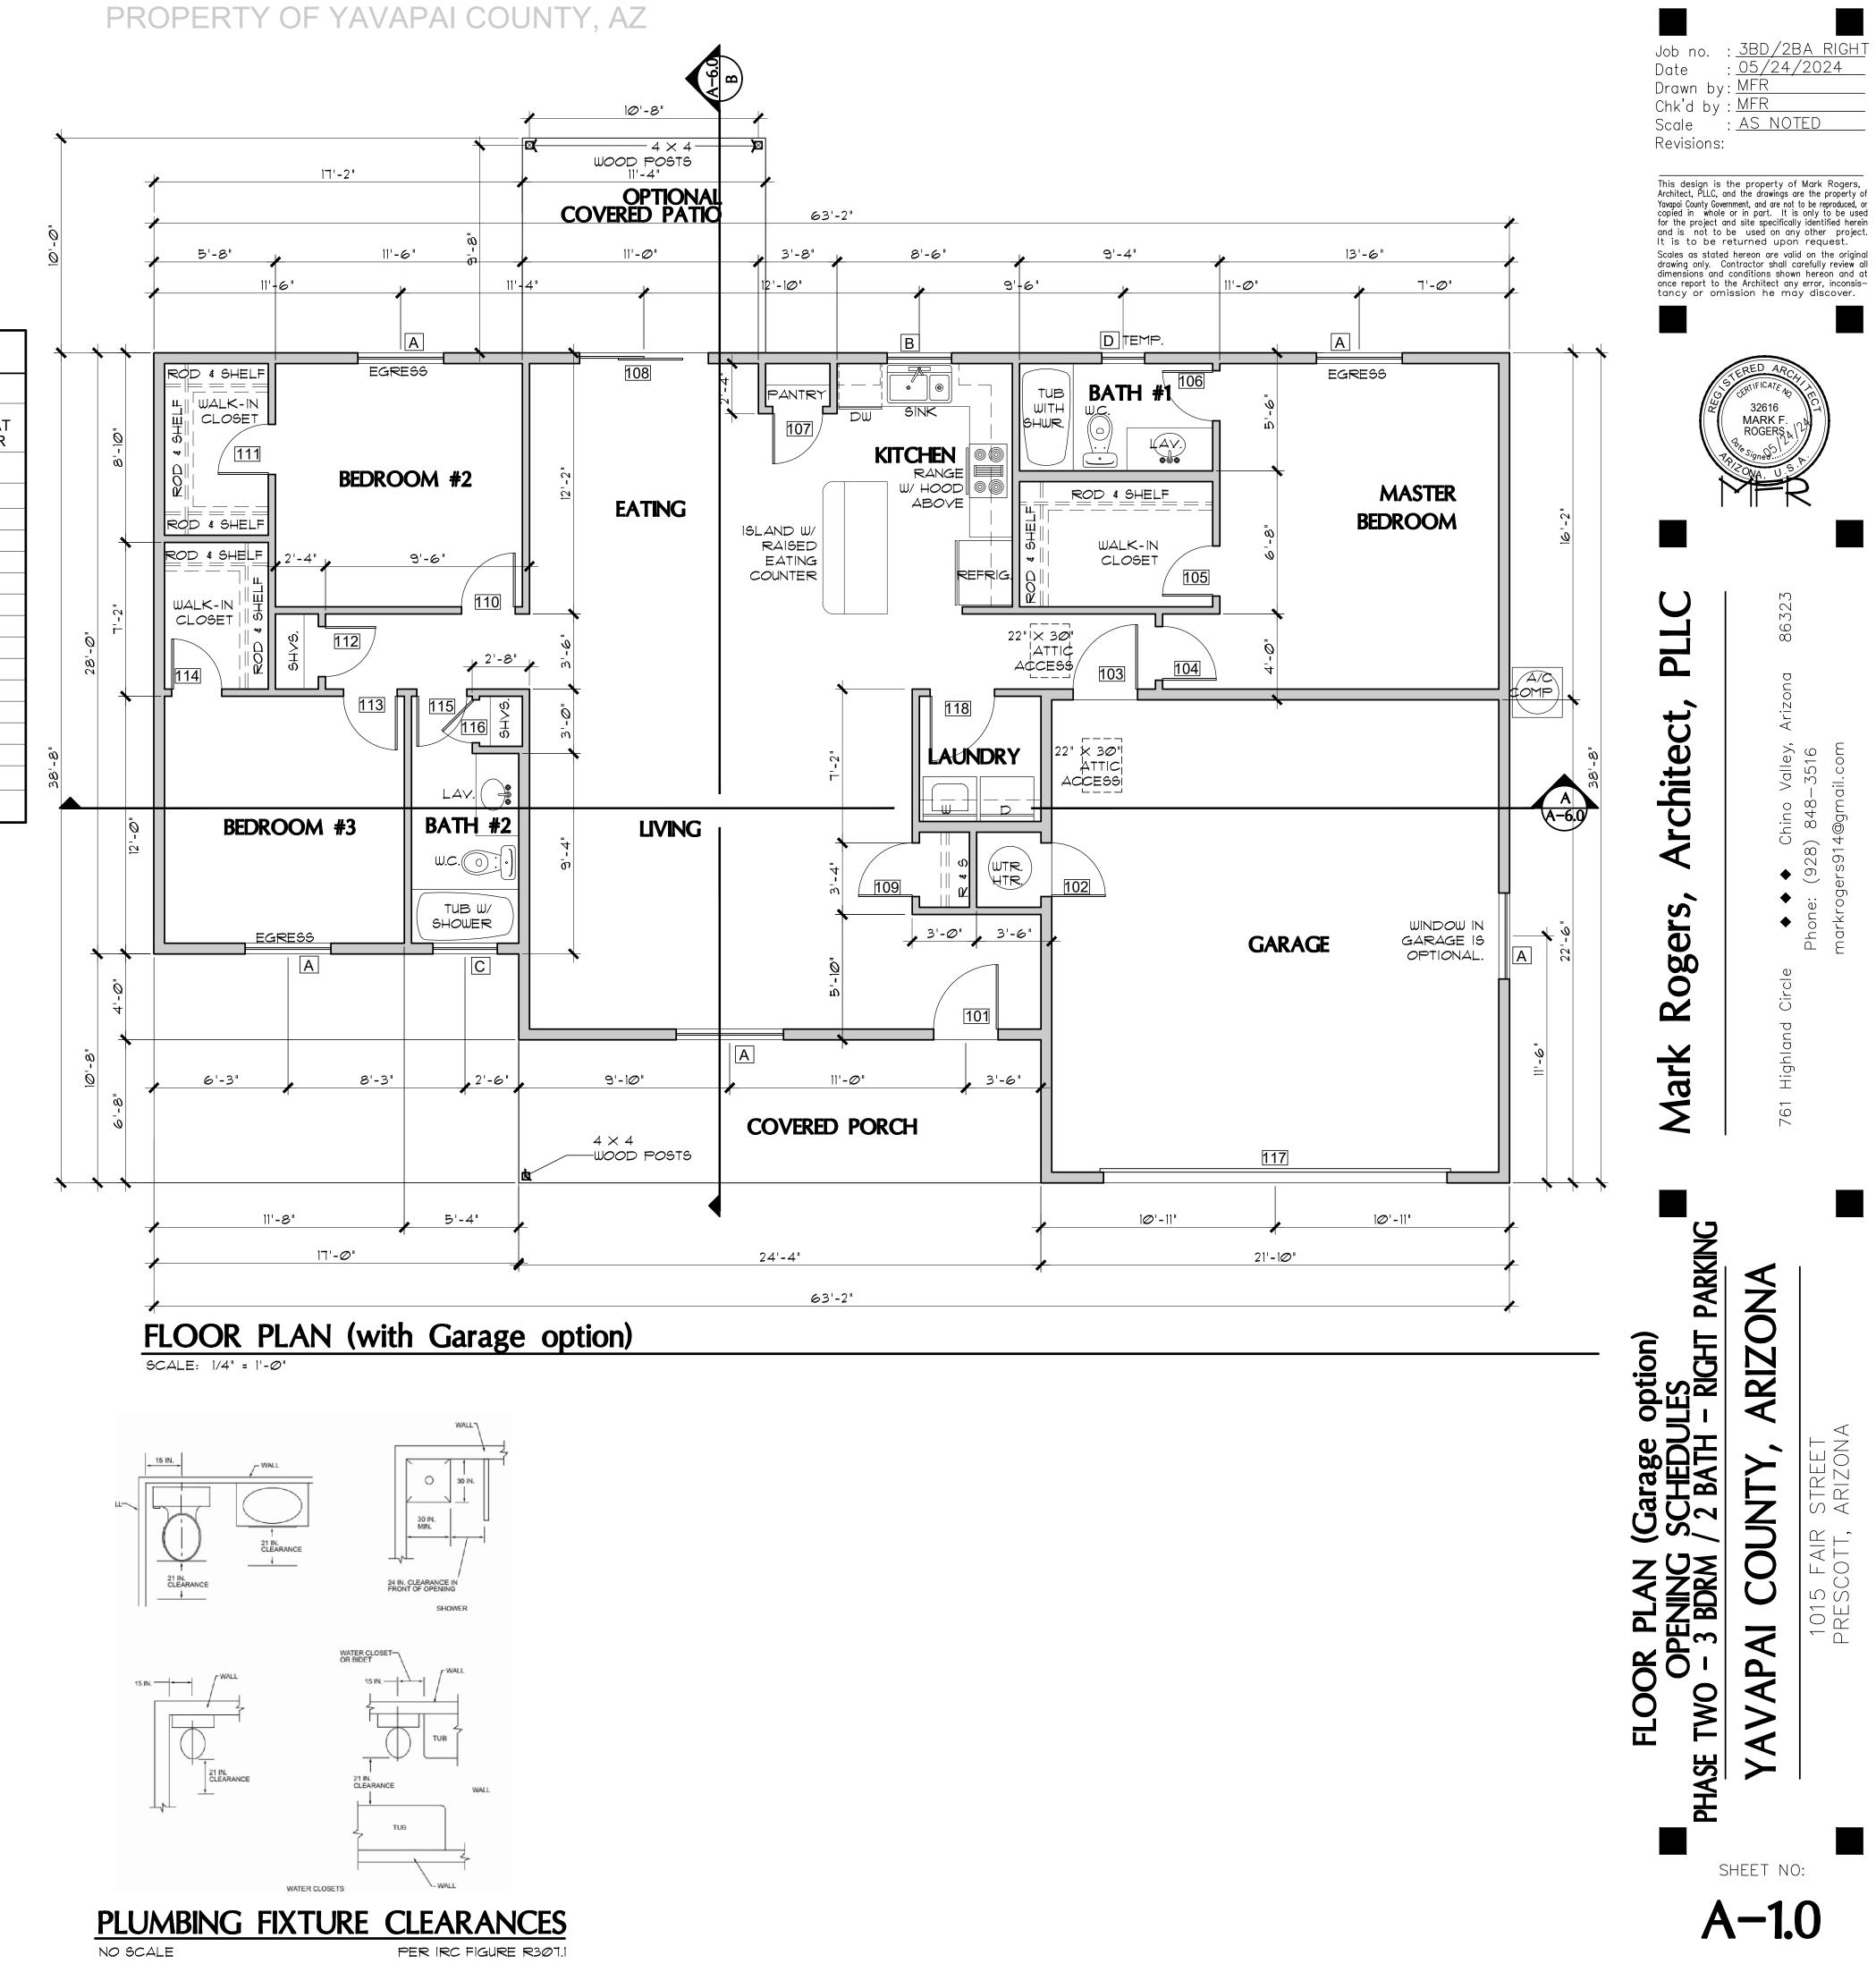

: AS NOTED

32616 MARK F.

**ARIZON** 

SHEET NO:

A-1.0

# REVIEWED FOR DESIGN CRITERIA ONLY

SEE ATTACHED COVER SHEET FOR ALL STAMPS. IT IS THE RESPONSIBILITY OF THE OWNER/APPLICANT TO REVIEW AND ACKNOWLEDGE APPLICABLE STAMPS.

# PERTY OF YAVAPAI COUNTY, AZ

#### DOOR SCHEDULE

				DOOK JCHLDOLL	
DR.	SIZE			DOOR TYPE	
#	W.	H.	T.		REMARKS
101	3'-0"	6'-8"	1-3/4"	SOLID-CORE WOOD	
102	2'-6"	6'-8"	1-3/4"	SOLID-CORE WOOD	IF USING GAS WATER HEATER, PROVIDE 12" X 12" VENTS, ONE AT THE TOP, AND BOTTOM OF DOOR
103	3'-0"	6'-8"	1-3/4"	SOLID-CORE WOOD	SELF-CLOSING HINGES AND SELF-LATCHING HARDWARE
104	2'-8"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
105	2'-4"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
106	2'-4"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
107	2'-4"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
108	6'-0"	6'-8"	-	SLIDING GLASS PATIO DOOR	
109	2'-6"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
110	2'-6"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
111	2'-4"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
112	2'-4"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
113	2'-6"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
114	2'-4"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
115	2'-4"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
116	2'-0"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	
117	3'-0"	6'-8"	1-3/8"	INTERIOR HOLLOW CORE	

NOTE: WHEN USING DOOR #2 WITH THE ALTERNATE CARPORT, SELF-CLOSING & SELF-LATCHING ARE NOT REQUIRED.


# WINDOW SCHEDULE (8' plate height)


WIN.							
VVIIN.	SIZE	TYPE	REMARKS				
Α	4040	XO	EGRESS AT BEDROOM				
В	3030	XO					
С	3010	ХО					
D	2030	SINGLE-HUNG	TEMPERED GLAZING				

# WINDOW SCHEDULE (9' plate height)

WIN.	SIZE	TYPE	REMARKS
Α	4050	XO	EGRESS AT BEDROOM MUST HAVE MAX. 44" SILL HEIGHT ABOVE FLOOR
В	3030	XO	
С	3010	XO	
D	2030	SINGLE-HUNG	TEMPERED GLAZING

NOTE: FENESTRATION IN ZONE 2 (ELEVATIONS BELOW 3500 FT.) SHALL HAVE A MAXIMUM U-FACTOR OF 0.75, AND A MAXIMUM FENESTRATION SHGC FACTOR OF 0.40. FENESTRATION IN ZONE 4 (ELEVATIONS 3500 FT. AND ABOVE) SHALL HAVE A MAXIMU U-FACTOR OF 0.40. THE SHGC FACTOR IN ZONE 4 IS NOT APPLICABLE.

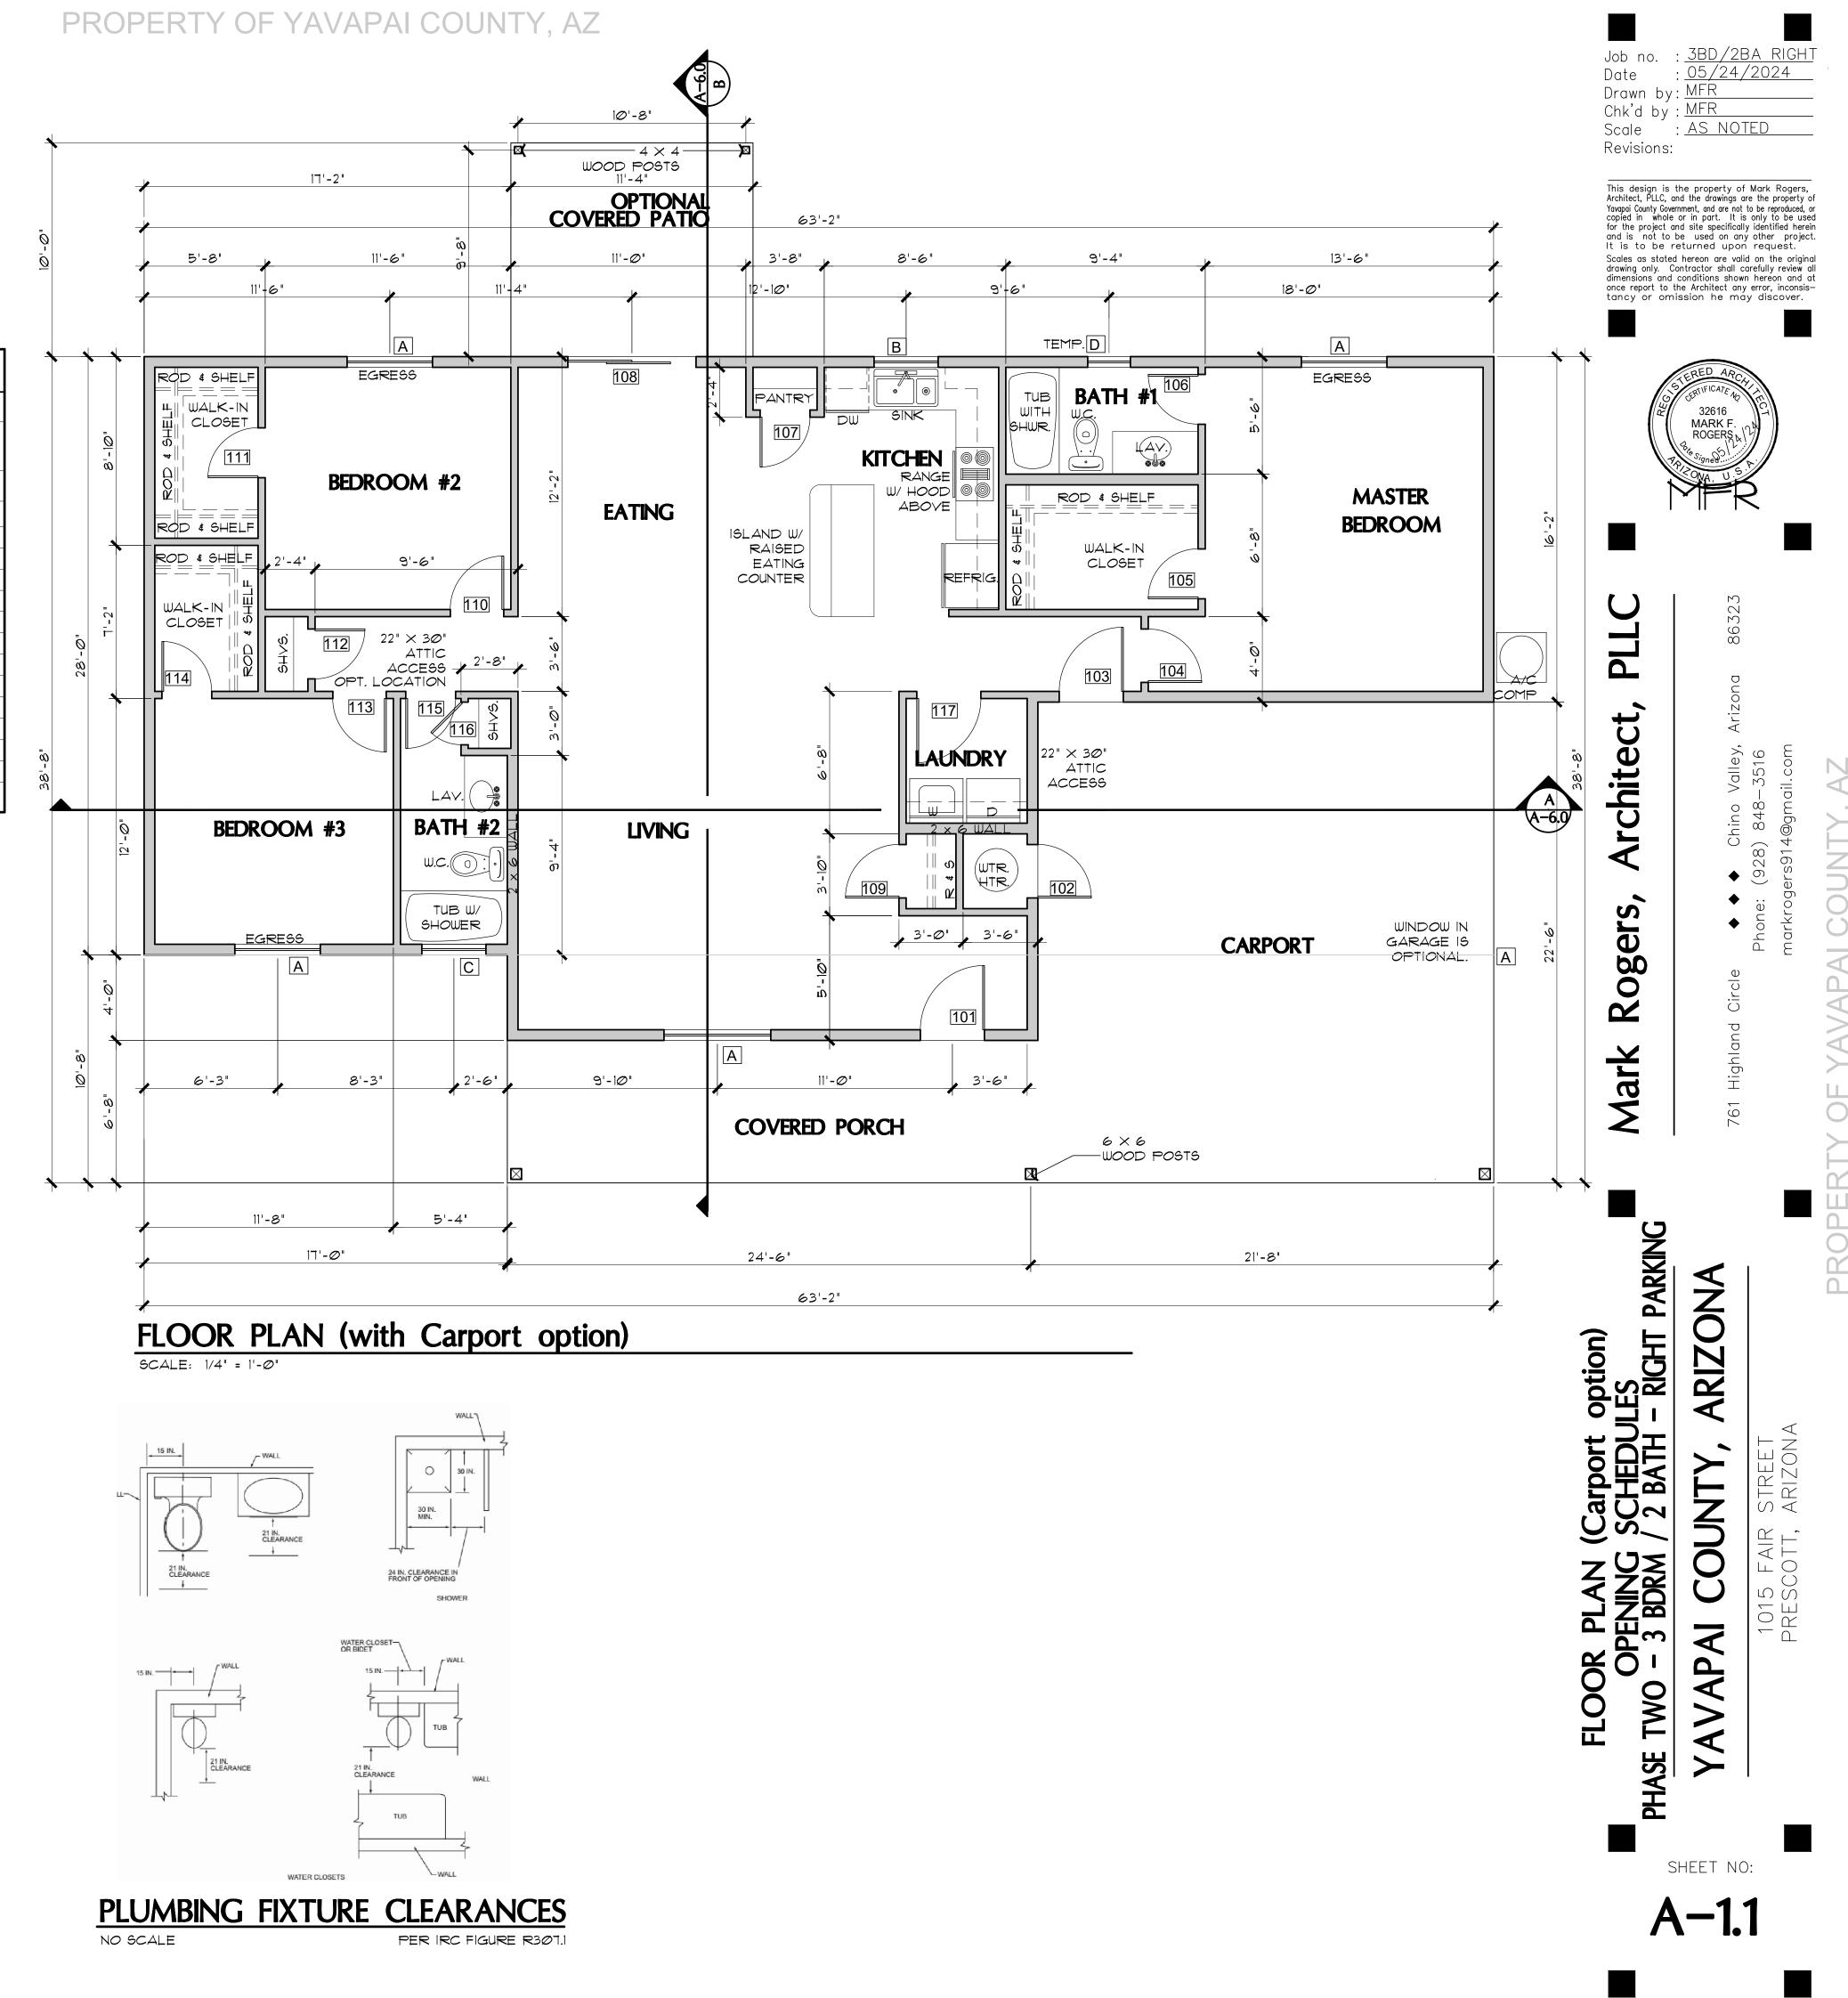

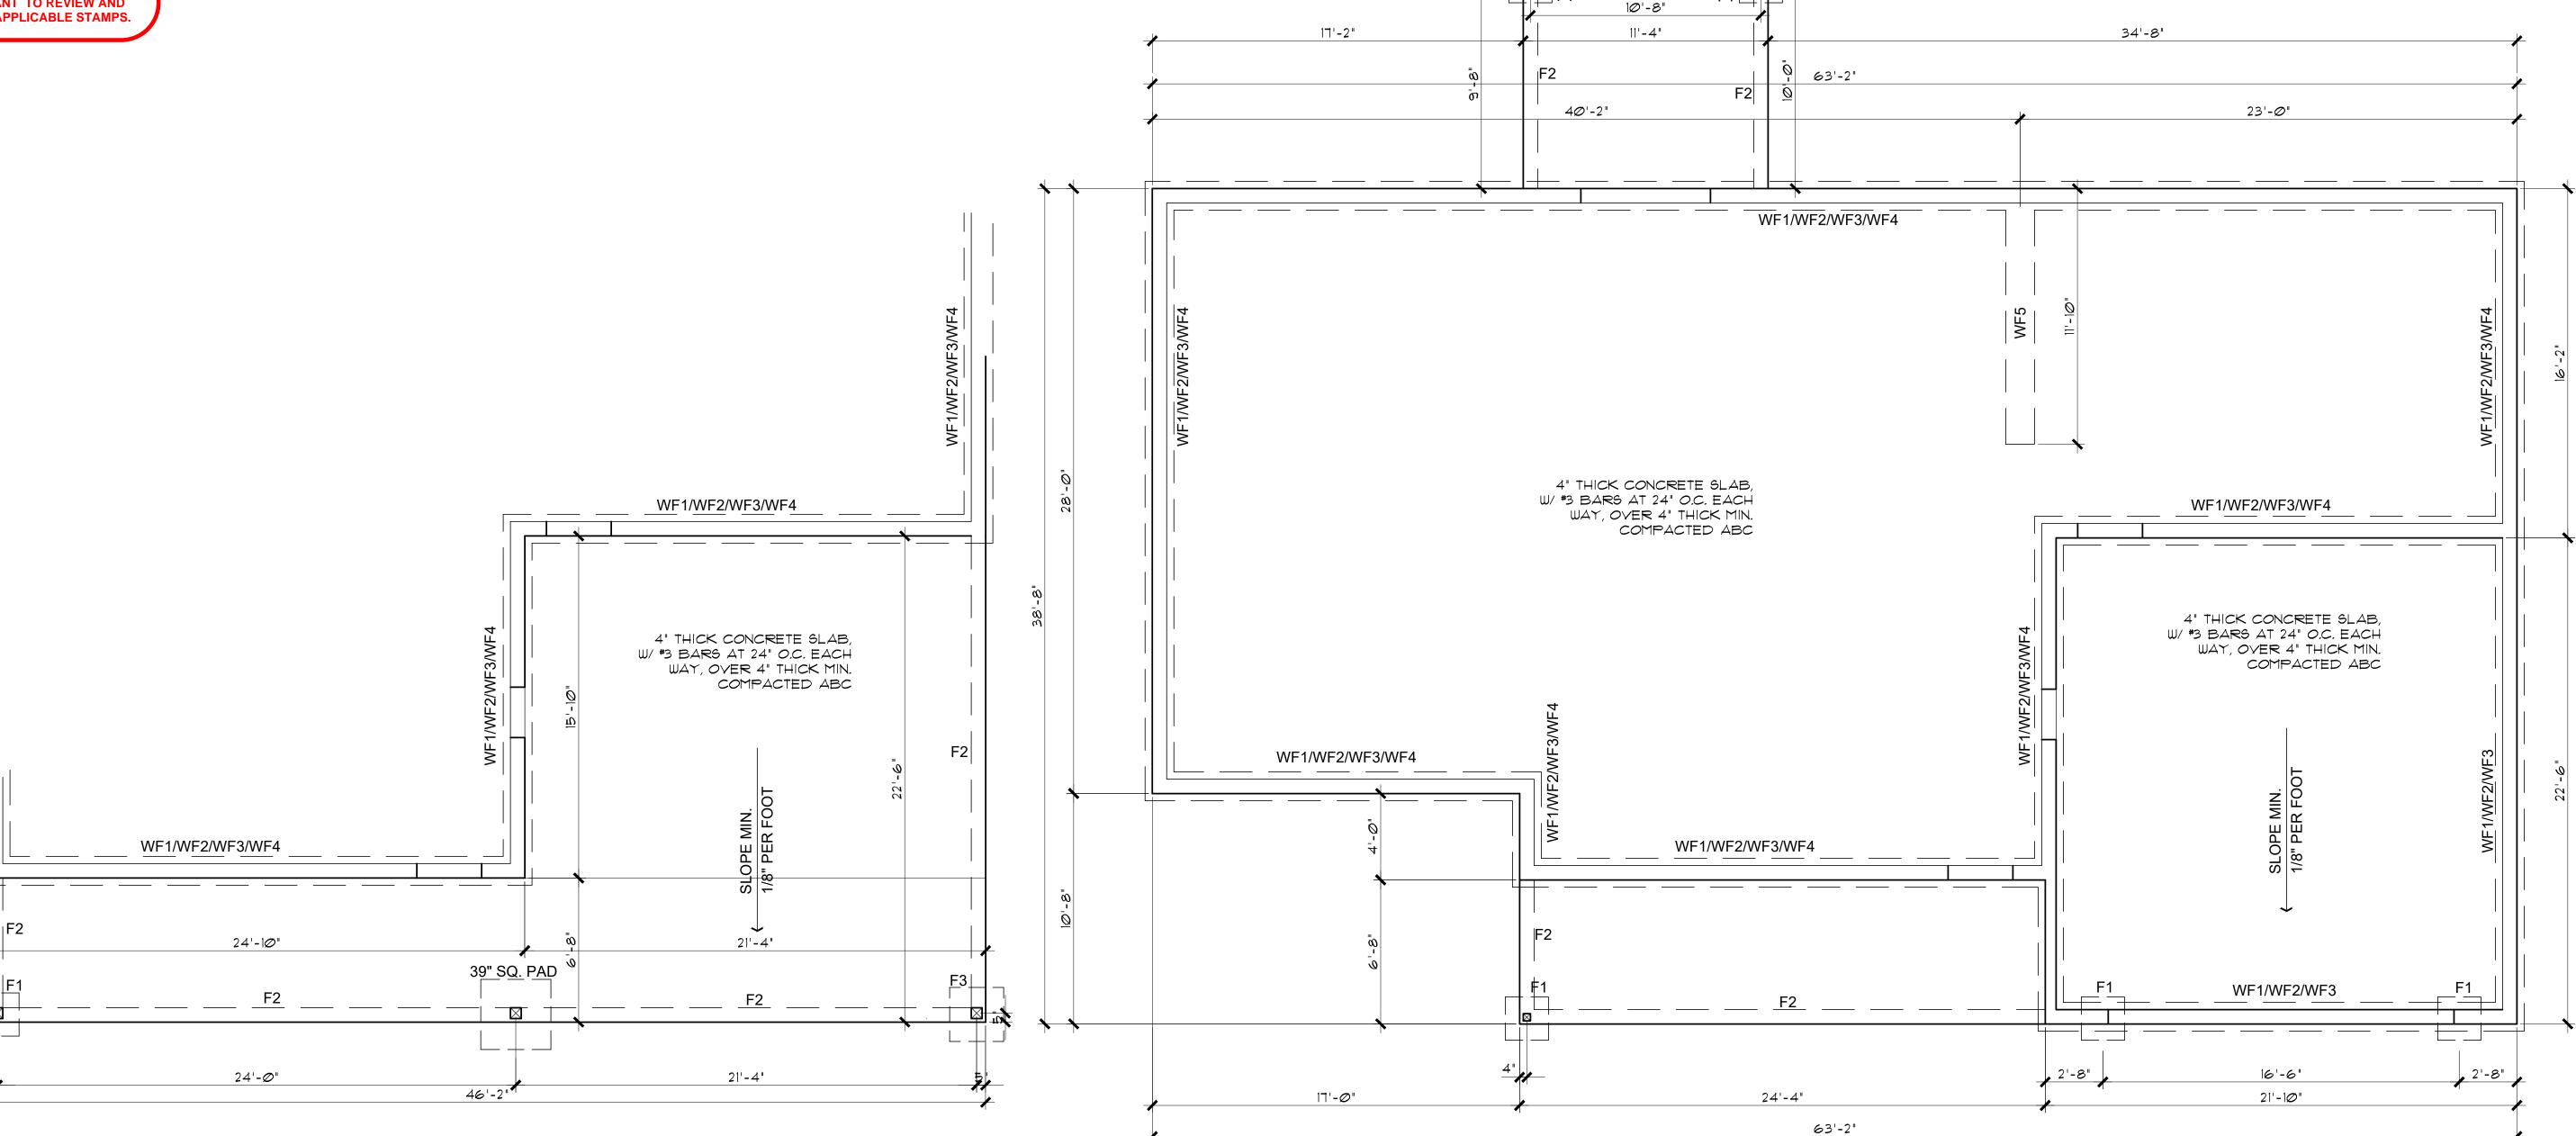

PROPERTY OF YAVAPAI COUNTY, AZ

## FOUNDATION PLAN (with Carport option)

SCALE: 1/4" = 1'-0"

# FOUNDATION NOTES

1. FOOTINGS TO BE A MIN. OF 8" THICK IN 18" MIN. UNDISTURBED SOIL.

- 2. FOOTINGS AND INTERIOR FLATWORK TO BE MIN. 2500 P.S.I. MIN COMPRESSIVE STRENGTH AT 28 DAYS.
- 3. FOUNDATION SUPPORTED WOOD TO EXTEND MIN. 6" ABOVE
- 4. FOUNDATION PLATES AND SILLS SHALL BE BOLTED TO FOUNDATION WITH MIN. 1/2" BOLTS 6'-0" O.C., 12" FROM
- CORNERS AND EMBEDDED 7" INTO FOUNDATION WALL
- 5. EXTERIOR FLATWORK SLOPE TO BE 1/4" PER FOOT. 6. CONTRACTOR TO EMBED 20' OF #4 G.A. COPPER WIRE IN FOOTING FOR ELECTRICAL SERVICE GROUND.
- 7. THE GRADE AWAY FROM FOUNDATION WALLS SHALL FALL
- A MINIMUM OF 6 INCHES WITHIN THE FIRST 10 FEET.
- 8. ALL EXTERIOR PLATES, LOAD BEARING AND NON LOAD BEARING SHALL BE PRESSURE TREATED, LESS THAN 8" ABOVE GRADE
- 9. FILL BEING PLACED THAT EXCEEDS 2' WILL REQUIRE A CERTIFIED COMPACTION TEST AND REPORT.

NOTE: THE FOOTINGS SIZE, THICKNESS, AND BOTTOM OF FOOTING DEPTH SHALL BE PER THE GEOTECHNICAL REPORT/ENGINEER'S REQUIREMENTS. THIS SHALL INCLUDE ANY OVER EXCAVATIONS, ENGINEERED PAD REQUIREMENTS, AND/OR A CHANGE IN DEPTH, AND TYPE OF BASE COURSE UNDER THE CONCRETE SLABS.

# FOUNDATION PLAN (with Garage option)

SCALE: 1/4" = 1'-0"

# SEE SHEET A-7.0 FOR FOUNDATION DETAILS

# 1WO SHEET NO: A - 2.0

: AS NOTED

This design is the property of Mark Rogers, Architect, PLLC, and the drawings are the property of Yavapai County Government, and are not to be reproduced, or copied in whole or in part. It is only to be used for the project and site specifically identified herein and is not to be used on any other project.

Scales as stated hereon are valid on the original drawing only. Contractor shall carefully review all dimensions and conditions shown hereon and at

once report to the Architect any error, inconsistancy or omission he may discover.

32616 MARK F.


It is to be returned upon request.


Drawn by:

Revisions:


Scale

Chk'd by : MFR

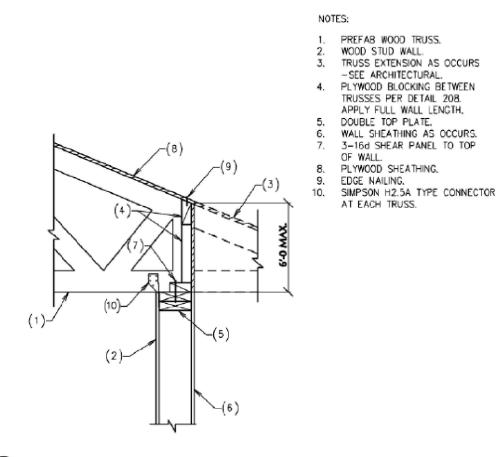


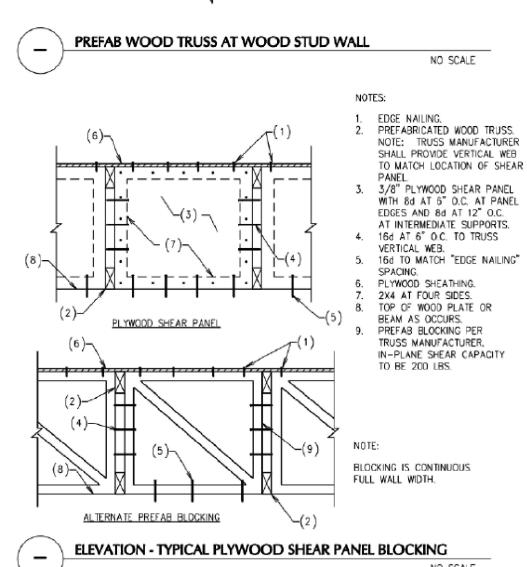

# PANEL BLOCKING DETAIL SCALE: 1/4" = 1'-@"

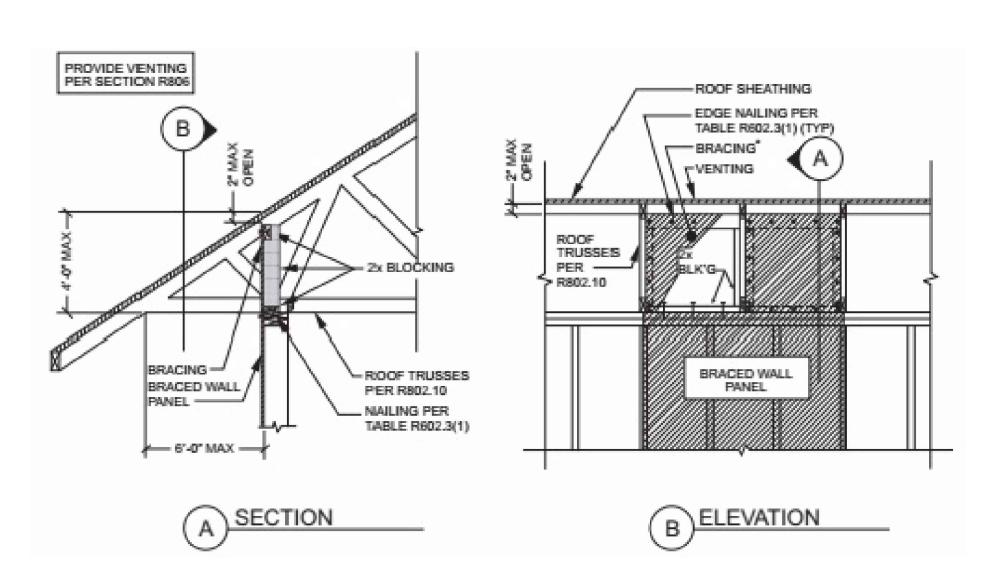

BRACED WALL PANEL CONNECTION OPTION AT PERPENDICULAR ROOF TRUSSES 2018 IRC FIGURE R602.10.8.2(3)

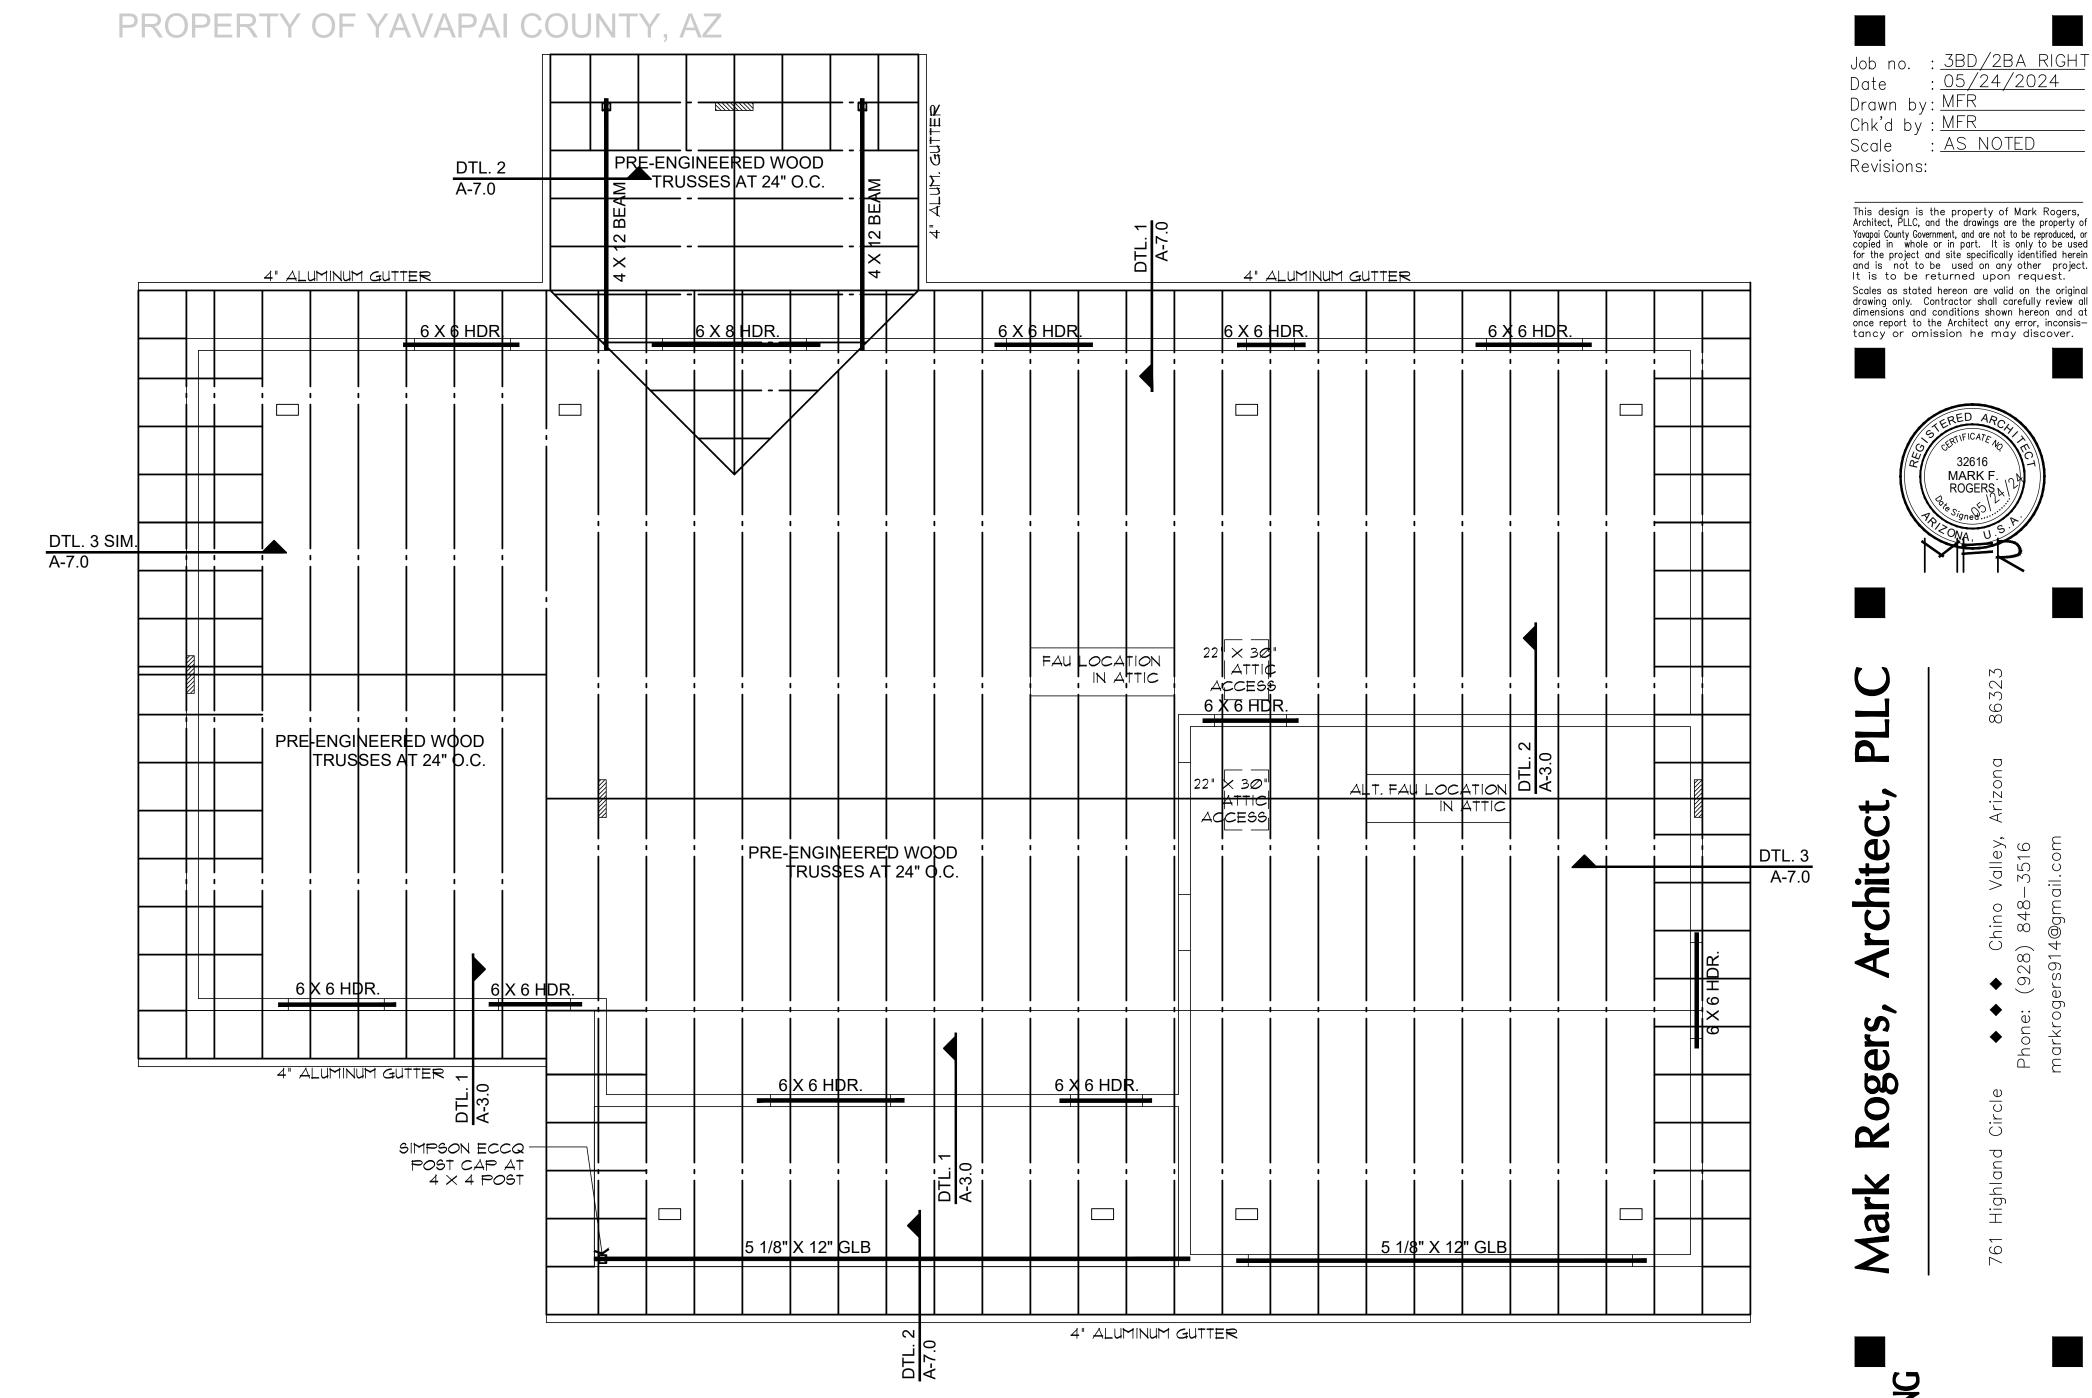

ROOF FRAMING PLAN (with optional Garage)

SCALE: 1/4" = 1'-0"

NOTE: PROVIDE PANEL EDGE SUPPORT FOR NARROW-WIDTH ROOF SHEATHING PER APA TECHNICAL REPORT #R275A

ROOF VENTILATION
REQUIRED 2373 SQ. FT. / 300 = 8 SQ. FT. (1,152 SQ. IN.)
USE 4 GABLE-END VENTS AT 144 SQ. IN. MINIMUM EACH VENT
576 SQ. IN. AT GABLE ENDS
8 O'HAGIN OR OTHER EQUAL LOW VENTS AT 72 SQ. IN. EACH

576 SQ. IN. LOW VENTS BIRDBLOCKS TO HAVE 3 HOLES, 2" DIA. EACH BOARD

#### **ROOF NOTES**

- . REFER TO TRUSS CALCULATIONS FOR FINAL ROOF FRAMING DESIGN.
- 2. SIMPSONS H2.5A HANGERS TO BE APPLIED @ ALL TRUSS ENDS
- 4. ROOF SHEATHING TO BE 1/2" CDX PLYWOOD OR OSB.
- 5. SUPPORTED MEMBERS OF G.L.B. & GIRDERS OR OTHER CONCENTRATED LOADS SUPPORTED BY WALL OR PIER SHALL HAVE BEARING AT LEAST AS WIDE AS THE ROOF
- 6. ROOF PITCH 4:12 (TYP.).
- 7. OVERHANGS TO BE 24".
- 8. FURNACE IN ATTIC: PROVIDE A 24" SOLID PASSAGEWAY TO CONTROL SIDE OF APPLIANCE AND A 30" SERVICE SPACE ON THE CONTROL SIDE OF THE APPLIANCE (REQUIRED FOR ATTIC MOUNT FURNACES)
- 9. ALL RAFTERS SHALL BE DOUGLAS FIR #2 (SIZE PER PLAN) ALL STUDS SHALL BE HEM FIR #2 (SIZE PER PLAN)

SEE ROOF FRAMING DETAILS SHEET A7.0

AN (Garage option) 2 BATH – RIGHT PARKING **ARIZONA** ROOF FRAMING | PHASE TWO - 3 BDRM

: AS NOTED

32616 MARK F.


۵


chite

Marl


A - 3.0

SHEET NO:

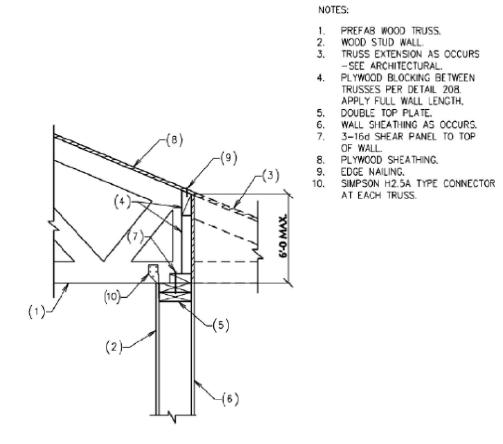


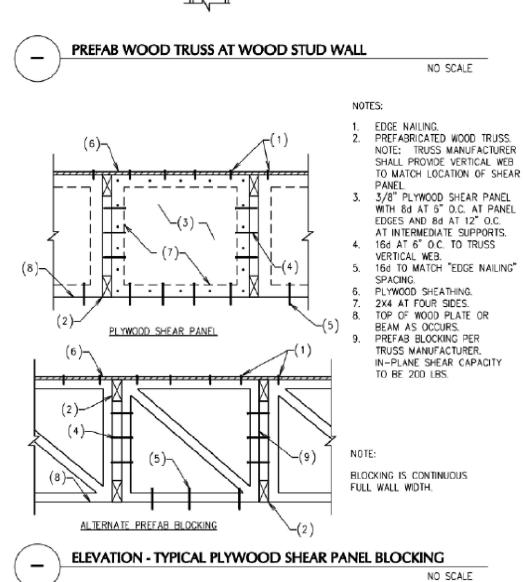



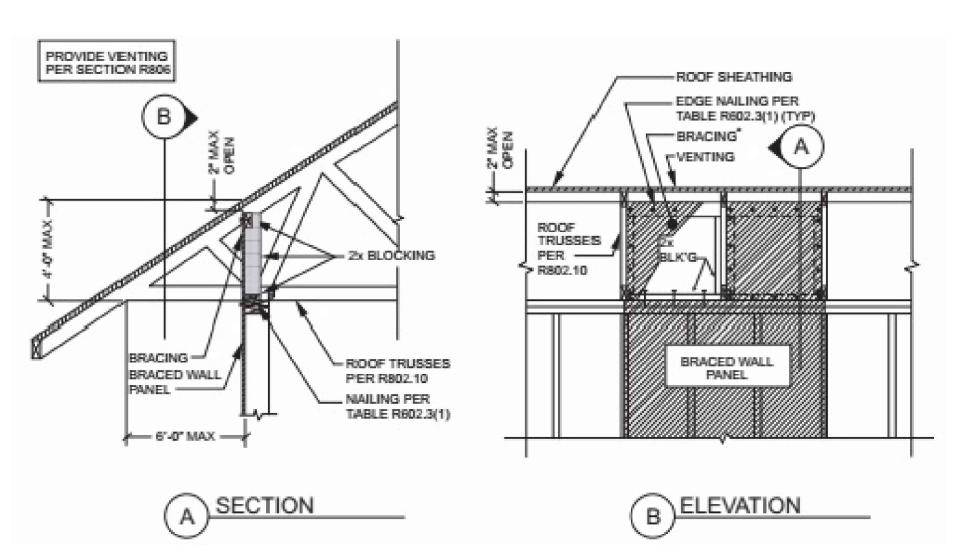

BRACED WALL PANEL CONNECTION OPTION AT PERPENDICULAR ROOF TRUSSES 2018 IRC FIGURE R602.10.8.2(3)

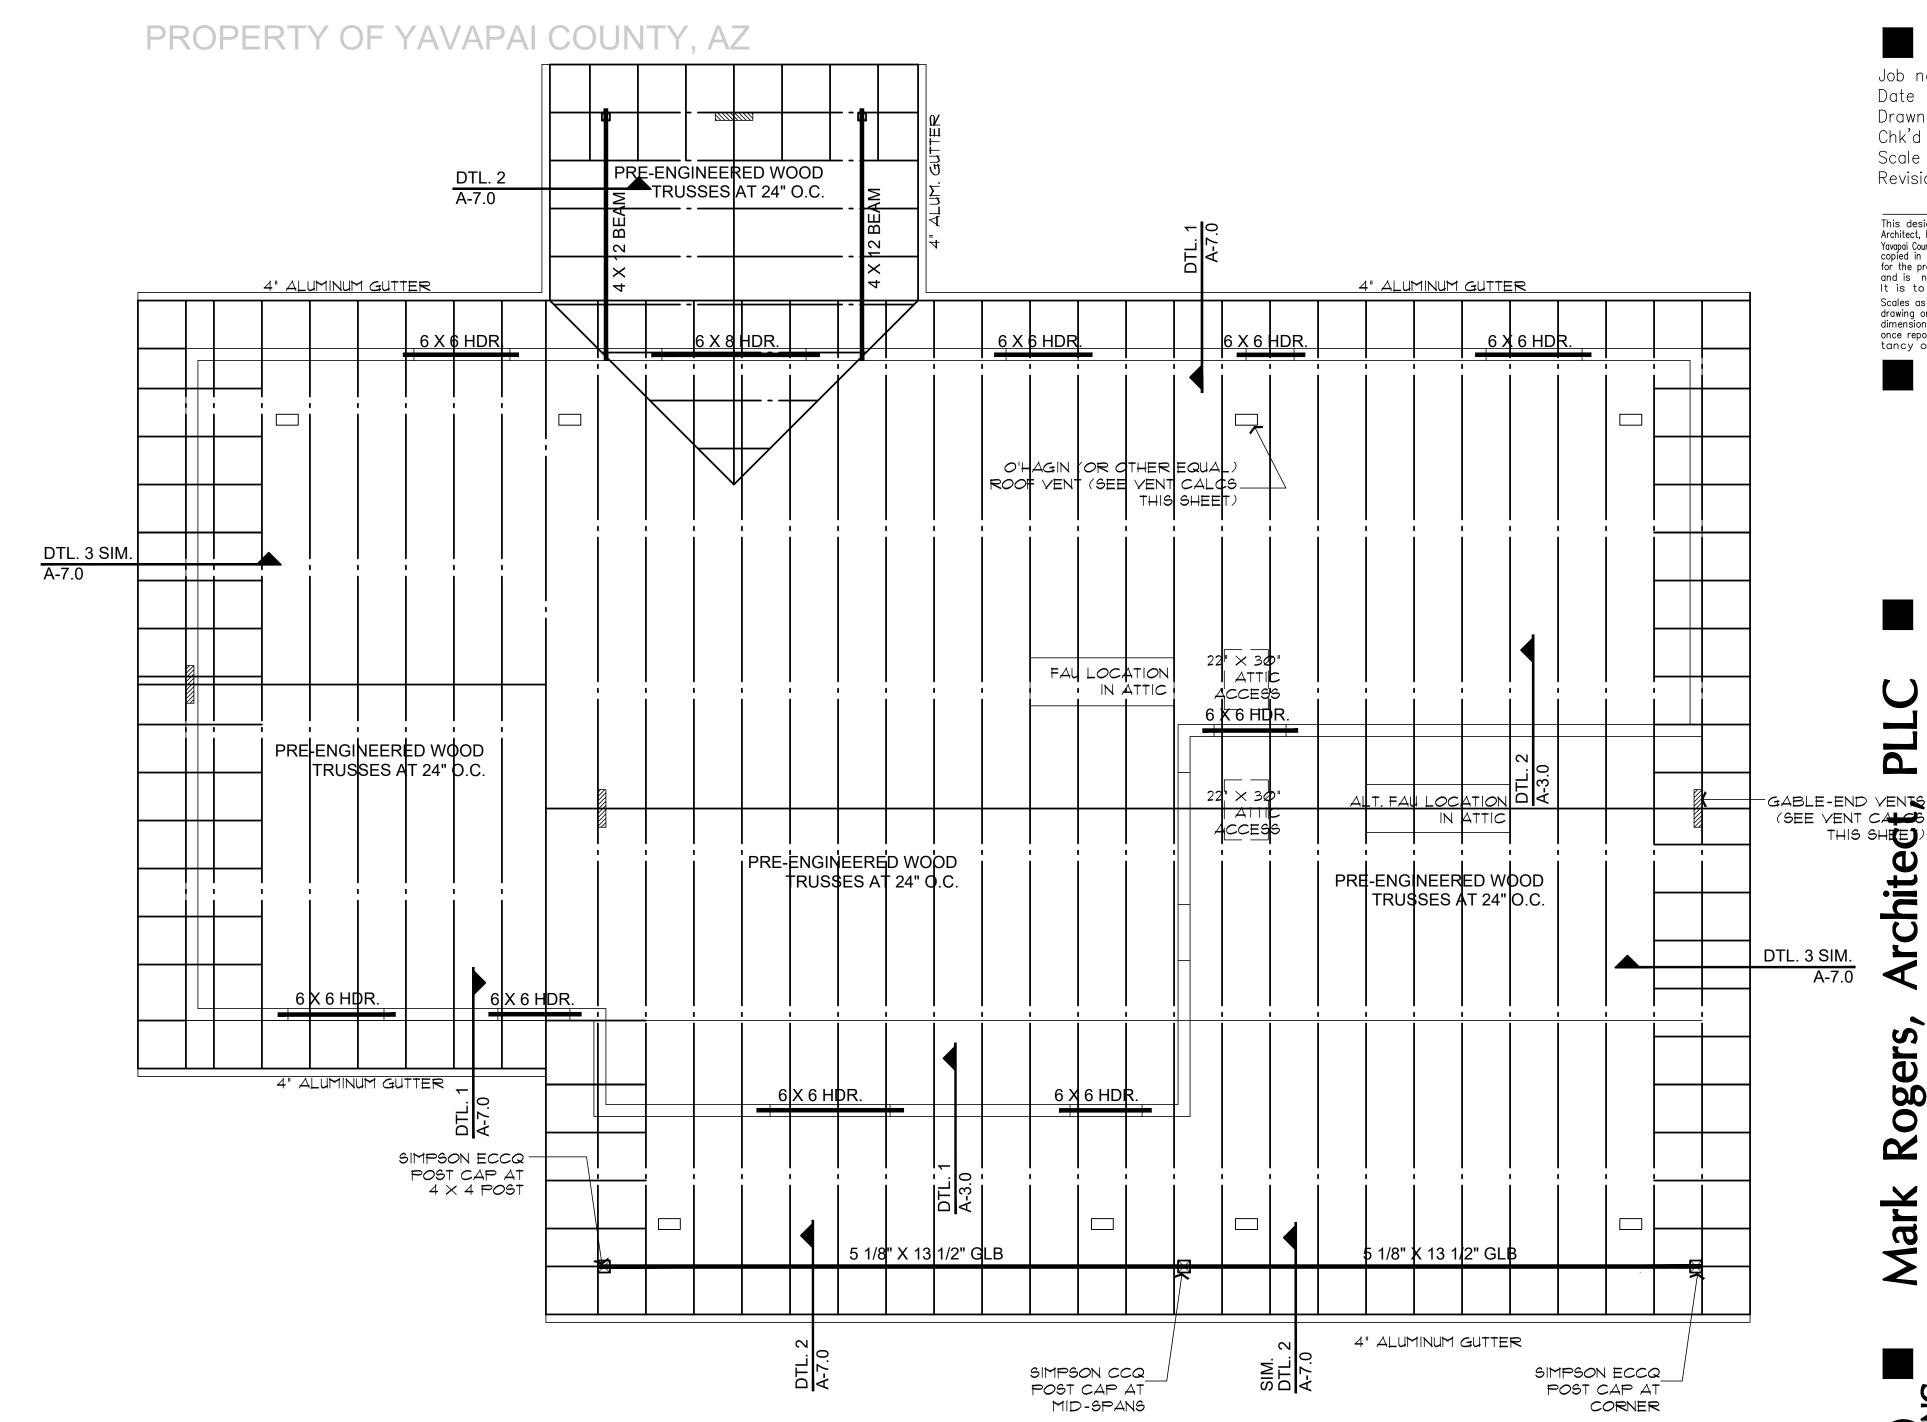

# ROOF FRAMING PLAN (with optional Carport)

SCALE: 1/4" = 1'-0"

NOTE: PROVIDE PANEL EDGE SUPPORT FOR NARROW-WIDTH ROOF SHEATHING PER APA TECHNICAL REPORT #R275A

ROOF VENTILATION
REQUIRED 2373 SQ. FT. / 300 = 8 SQ. FT. (1,152 SQ. IN.)
USE 4 GABLE-END VENTS AT 144 SQ. IN. MINIMUM EACH VENT
576 SQ. IN. AT GABLE ENDS
8 O'HAGIN OR OTHER EQUAL LOW VENTS AT 72 SQ. IN. EACH 576 SQ. IN. LOW VENTS

BIRDBLOCKS TO HAVE 3 HOLES, 2" DIA. EACH BOARD

#### **ROOF NOTES**

- 1. REFER TO TRUSS CALCULATIONS FOR FINAL ROOF FRAMING DESIGN.
- 2. SIMPSONS H2.5A HANGERS TO BE APPLIED @ ALL TRUSS
- 4. ROOF SHEATHING TO BE 1/2" CDX PLYWOOD OR OSB. 5. SUPPORTED MEMBERS OF G.L.B. & GIRDERS OR OTHER CONCENTRATED LOADS SUPPORTED BY WALL OR PIER SHALL HAVE BEARING AT LEAST AS WIDE AS THE ROOF
- 6. ROOF PITCH 4:12 (TYP.)
- 7. OVERHANGS TO BE 24".
- 8. FURNACE IN ATTIC: PROVIDE A 24" SOLID PASSAGEWAY TO CONTROL SIDE OF APPLIANCE AND A 30" SERVICE SPACE ON THE CONTROL SIDE OF THE APPLIANCE (REQUIRED FOR ATTIC MOUNT FURNACES)
- 9. ALL RAFTERS SHALL BE DOUGLAS FIR #2 (SIZE PER PLAN) ALL STUDS SHALL BE HEM FIR #2 (SIZE PER PLAN)

SEE ROOF FRAMING DETAILS SHEET A7.0

AN (Carport option) 2 BATH - RIGHT PARKING **ARIZONA** ROOF FRAMING PL PHASE TWO - 3 BDRM / SHEET NO:

 $\simeq$ 

Marl

Drawn by

Revisions:

Scale

Chk'd by : MFR

: AS NOTED

This design is the property of Mark Rogers, Architect, PLLC, and the drawings are the property of

Yavapai County Government, and are not to be reproduced, or copied in whole or in part. It is only to be used for the project and site specifically identified herein and is not to be used on any other project.

It is to be returned upon request. Scales as stated hereon are valid on the original drawing only. Contractor shall carefully review all dimensions and conditions shown hereon and at once report to the Architect any error, inconsis-

tancy or omission he may discover.

32616


MARK F.

PROPERTY OF YAVAPAI COUNTY. AZ

A - 3.1


OWNER/APPLICANT TO RE							1		1				
ACKNOWLEDGE APPLICABL	E STA	MPS/IND S EED (MPH)			115		115		115	j	115		115
		BRA CED WALL LINE			Α		В		С				
		STORY	Ì	<del>\textstyle{\textstyle{\textstyle{X}}}</del>		<u> </u>		<u> </u>					
	BR	ACED WALL PANEL METHO	)D	CS-WSF	CS-PF CS-G		GB	CS-WSF	CS-PF CS-G				
		AVG BWL SPACING (ft)		2	1.83	4	1.33		32	1			
		TABULAR REQUIRED (ft)			2.92	L	7.25	į.	4.80	İ			
		EXPOSURE		С	1.20	c	1.20	С	1.20	c [		С	
		EAVE-RIDGE HT (ft)		7.00	0.82	7.00	0.82	7.00	0.82				
	Ξ	STORY HEIGHT (ft)		9.00	0.95	9.00	0.95	9.00	0.95				
	ADJUSTMENT	# BWLs		3.00	1.30	3.00	1.30	3.00	1.30				
	Į	ADD PAIR 800# HOLD DOWNS		NO	1.00	NO	1.00	NO	1.00				
	₹	OMIT INTERIOR GB		NO	1.00	NO	1.00	NO	1.00				
		METHOD GB FASTEN @	4" o.c	ИО	1.00	ИО	1.00	ИО	1.00				
		HORIZONTAL BLOCKING O	NO	1.00	NO	1.00	NO	1.00					
	REQUIRED BWP LENGTH (ft)		`	3.55		8.81		<b>5</b> .83		į			
			BWP	METHOD	LENGTH (ft)	METHOD	LENGTH (ft)	METHOD	LENGTH (ft)	METHOI	D LENGTH (ft)	METHOD	LENGTH (ft)
			1	CS-WSP	4.00	DS - GB	5.83	CS-WSP	4.00				
	BWP		2	CS-WSP	4.00	DS - GB	6.00	CS-WSP	4.00				
	一一	CONTRIBUTING LENGTH	3	CS-WSP	4.00	CS-WSP	6.67						
	ACTUAL	CONTRIBUTING LENGTH	4										
	¥		5										
			6										
			7										
		ACTUAL BWP LENGTH (ft)		1	2.00	1	8.50	li li	8.00				
		ACTUAL ≥ REQUIRED		,	YES	,	YES	,	YES	1			
	SPACE	BWPs ≤ 20' APART			YES	1	YES	1	YES				
	# of	Length of BWL (ft)		3	8.67	3	88.67		28				
	BWPs	BWP 1 ≤ 16', 2 > 16'		1	YES	1	YES	,	YES	ļ			
N	ENDS	BWP WITHIN 10' OF EN	ND D	YES	YES	YES	YES	YES	YES				
N	LINDS	CONTINUOUS END COND	ITION	3	3	3	3	4	3				
	В	WL COMPLIANCE PASS-FA	IL	F	ASS	F	ASS	F	PASS	<u>i</u>			

	WIND SPEED (MPH)		115		115		115		115		115	
	BRACED WALL LINE			1		2		3		4		
	STORY											Î
BR	ACED WALL PANEL METHO	D O	CS-WSP	CS-PF CS-G		GB	CS-WSF	CS-PF CS-G	CS-WSF	°CS-PFCS-G		
	AVG BWL SPACING (ft)			6.16		22.5		32		22.5		
	TABULAR REQUIRED (ft)		1	2.92		7.25	2	4.80		3.75		
	EXPOSURE		С	1.20	С	1.20	С	1.20	С	1.20	С	
	EAVE-RIDGE HT (ft)		7.00	0.82	7.00	0.82	7.00	0.82	7.00	0.82		
Σ	STORY HEIGHT (ft)		9.00	0.95	9.00	0.95	9.00	0.95	9.00	0.95		
ADJUSTMENT	# BWLs		4.00	1.45	4.00	1.45	4.00	1.45	4.00	1.45		
Ĭ	ADD PAIR 800# HOLD DO	WNS	NO	1.00	ИО	1.00	NO	1.00	ИО	1.00		
₽	OMIT INTERIOR GB		NO	1.00	NO	1.00	NO	1.00	ИО	1.00		
	METHOD GB FASTEN @ 4" o.c		NO	1.00	ИО	1.00	ИО	1.00	ИО	1.00		
	HORIZONTAL BLOCKING OMITTED		NO	1.00	ИО	1.00	NO	1.00	МО	1.00		
F	REQUIRED BWP LENGTH (ft)		3.96		9.83			6.51	5.08			
		BWP	METHOD	LENGTH (ft)	METHOD	LENGTH (ft)	METHOD	LENGTH (ft)	METHOD	LENGTH (ft)	METHOD	LENGTH (ft)
		1	CS-WSP	4.00	DS - GB	8.00	CS-WSP	4.00	CS-WSP	2.92		
φ		2	CS-WSP	4.00	DS - GB	6.00	CS-WSP	4.00	CS-WSP	2.92		
¥   ₩	CONTRIBUTING LENGTH	3	CS-WSP	4.00			CS-WSP	4.00				
ACTUAL BWP	CONTRIBUTING LENGTH	4	CS-WSP	4.00								
¥		5										
		6										
		7										
	ACTUAL BWP LENGTH (ft)		1	6.00	1	4.00	1	2.00		5.84		
	ACTUAL ≥ REQUIRED		`	YES	,	/ES	,	YES	,	YES		
SPACE	BWPs ≤ 20' APART			YES	,	/ES	,	YES	1	YES		
# of	Length of BWL (ft)		6	3.16	2	1.83	4	1.33	2	21.83		
BWPs	BWP 1 ≤ 16', 2 > 16'			YES		/ES		YES		YES		
ENDS	BWP WITHIN 10' OF EN	ID	YES	YES	YES	YES	YES	YES	YES	YES		
	CONTINUOUS END COND		3	3								
B	WL COMPLIANCE PASS-FA	L	P	ASS	F	ASS	F	ASS	F	PASS		

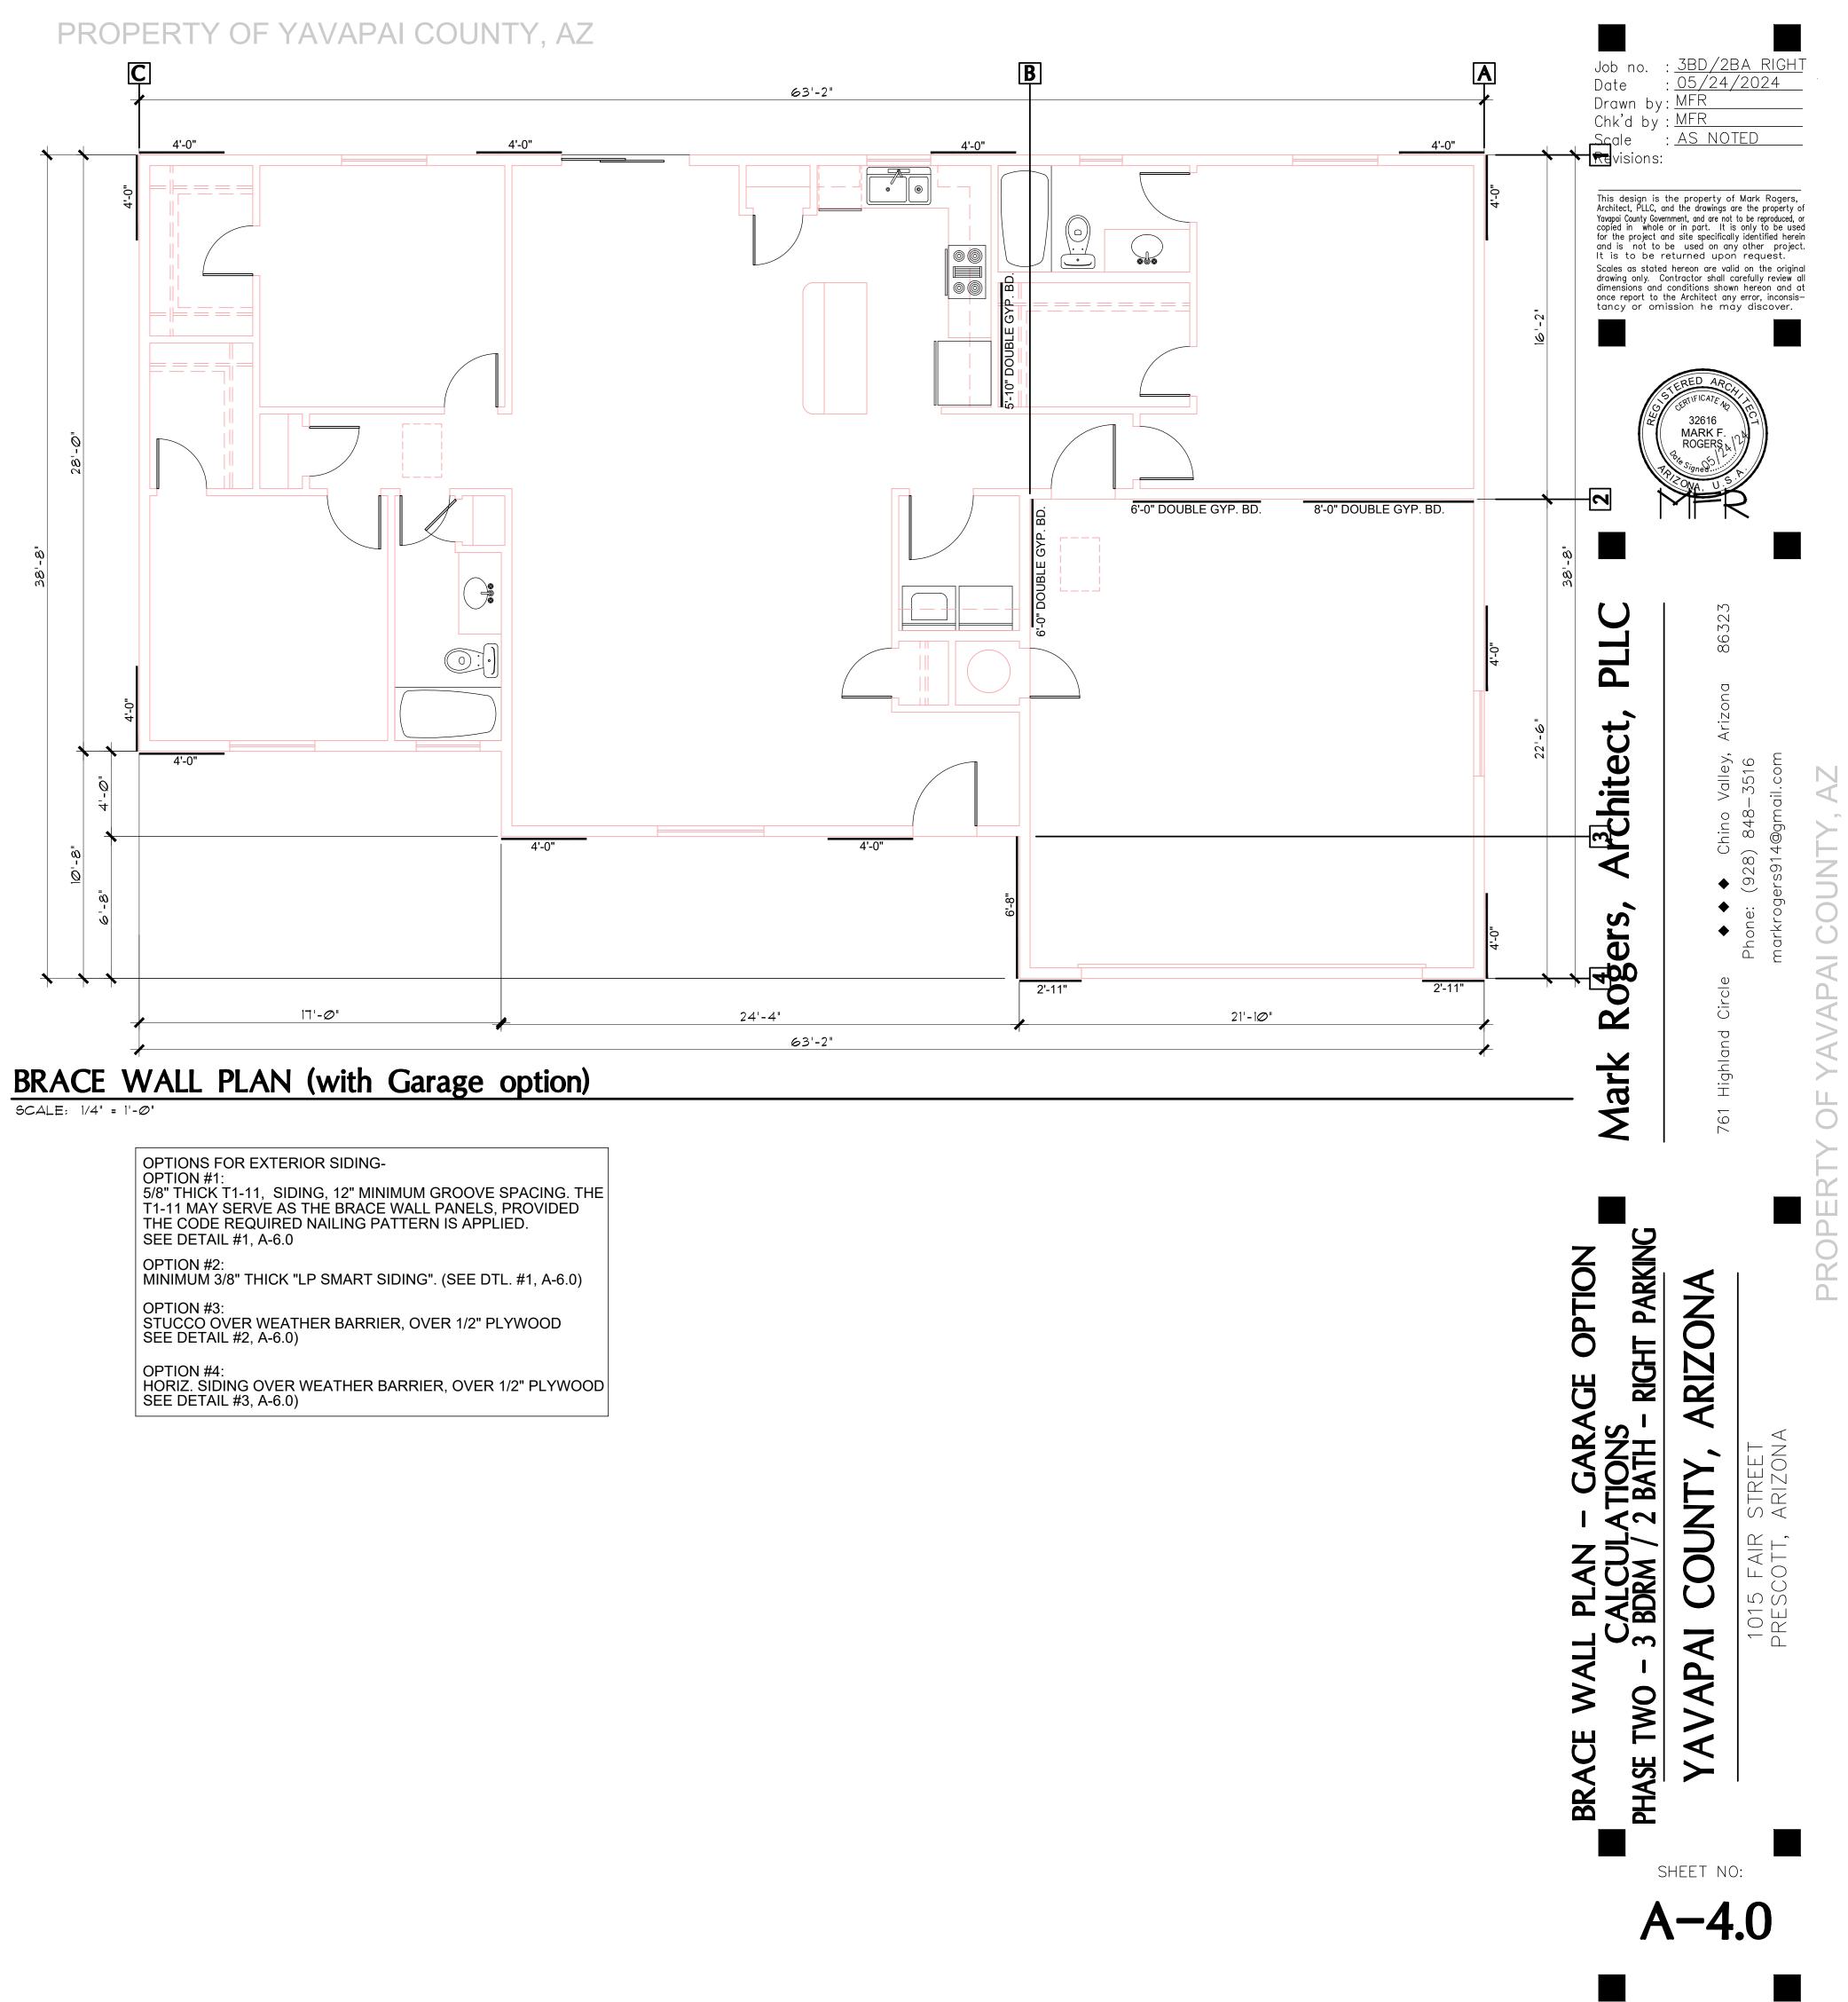

IEW AN	ND PS.				T	1	Г	1			T	
	Ward SPEED (MPH) 115					115		115	i	115		115
	BRACED WALL LINE		1			2		3				
	STORY											
BR	ACED WALL PANEL METHO	DD D	CS-WSP	CS-PF CS-G	CS-WSF	°CS-PF CS-G	CS-WSF	CS-PF CS-G				
	AVG BWL SPACING (ft)		1	6.16	1	16.16		32				
	TABULAR REQUIRED (ft)		2	2.92		2.92	2	4.80	İ			
	EXPOSURE		С	1.20	С	1.20	С	1.20	С		С	
	EAVE-RIDGE HT (ft)		7.00	0.82	7.00	0.82	7.00	0.82				
Ä	STORY HEIGHT (ft)		9.00	0.95	9.00	0.95	9.00	0.95				
ADJUSTMENT	# BWLs		3.00	1.30	3.00	1.30	3.00	1.30				
ž	ADD PAIR 800# HOLD DO	WNS	NO	1.00	NO	1.00	NO	1.00				
¥	OMIT INTERIOR GB		NO	1.00	NO	1.00	NO	1.00				
	METHOD GB FASTEN @ 4" o.c		NO	1.00	NO	1.00	NO	1.00				
	HORIZONTAL BLOCKING OMITTED		NO	1.00	NO	1.00	NO	1.00				
F	REQUIRED BWP LENGTH (ft)		3.55		12	3.55	8	5.83				
		BWP	METHOD	LENGTH (ft)	METHOD	LENGTH (ft)	METHOD	LENGTH (ft)	METHOD	LENGTH (ft)	METHOD	LENGTH (ft)
		1	CS-WSP	4.00	CS-WSP	4.00	CS-WSP	4.00				
BVAP BVAP		2	CS-WSP	4.00	CS-WSP	4.00	CS-WSP	4.00				
4	CONTRIBUTING LENGTH	3	CS-WSP	4.00			CS-WSP	4.00				
TUAL	SOUTH ASSETTION FOR THE SECTION OF T	4	CS-WSP	4.00								
Ş		5										
		6										
		7								-		
	ACTUAL BWP LENGTH (ft)		1	6.00		8.00	1	2.00				
	ACTUAL ≥ REQUIRED		)	YES	,	YES	,	YES	1			
SPACE	BWPs ≤ 20' APART		`	YES	,	YES	`	YES				
# of	Length of BWL (ft)		6	3.16	2	21.83		1.33				
BWPs	BWP 1 ≤ 16', 2 > 16			YES	,	YES	,	YES				
ENDS	BWP WITHIN 10' OF E	ID	YES	YES	YES	YES	YES	YES				
	CONTINUOUS END COND	ПОИ	3	3	3	1	4	3				
В	WL COMPLIANCE PASS-FA	IL	P	ASS	F	PASS	F	ASS				

						1		1				
	WIND SPEED (MPH)			115		115		115	Í	115	115	
	BRACED WALL LINE			Α	В		С					
	STORY						â					
BR	ACED WALL PANEL METHO	O.	CS-WSF	CS-PF CS-G		GB	CS-VSF	CS-PFICS-G				
	AVG BWL SPACING (ft)		2	1.83	4	1.33		32				
	TABULAR REQUIRED (ft)		:	2.92	Ī	7.25		4.80	İ			
	EXPOSURE		С	1.20	С	1.20	С	1.20	С		С	
	EAVE-RIDGE HT (ft)		7.00	0.82	7.00	0.82	7.00	0.82				
Ë	STORY HEIGHT (ft)		9.00	0.95	9.00	0.95	9.00	0.95				
STME	# BWLs		3.00	1.30	3.00	1.30	3.00	1.30				
ADJUSTMENT	ADD PAIR 800# HOLD DO	WNS	NO	1.00	NO	1.00	NO	1.00				
₹	OMIT INTERIOR GB		NO	1.00	NO	1.00	NO	1.00				
	METHOD GB FASTEN @	4" o.c	NO	1.00	NO	1.00	NO	1.00				
	HORIZONTAL BLOCKING OMITTED		NO	1.00	NO	1.00	NO	1.00				
F	REQUIRED BWP LENGTH (ft)		;	3.55	8.81		ļ	5.83				
		BWP	METHOD	LENGTH (ft)	METHOD	LENGTH (ft)	METHOD	LENGTH (ft)	METHOD	LENGTH (ft)	METHOD	LENGTH (ft)
		1	CS-WSP	4.00	DS - GB	5.83	CS-WSP	4.00				
<u>B</u>		2	CS-WSP	4.00	DS - GB	6.00	CS-WSP	4.00				
TUAL BWP	CONTRIBUTING LENGTH	3	CS-WSP	4.00	CS-WSP	6.67						
) D	CONTRIBUTING LENGTH	4	palamata and an an an an an an an an an an an an an									
AC		5										
		6										
		7										
,	ACTUAL BWP LENGTH (ft)		1	2.00	1	8.50		8.00	l L			
	ACTUAL ≥ REQUIRED		,	YES	,	YES	,	YES	İ			
SPACE	BWPs ≤ 20' APART		,	YES	,	YES	,	YES				
# of	Length of BWL (ft)		3	8.67	3	8.67		28				
BWPs	BWP 1 ≤ 16', 2 > 16'		1	YES	1	YES	1	YES	I I			
ENDS	BWP WITHIN 10' OF EN	ID	YES	YES	YES	YES	YES	YES				
LNDS	CONTINUOUS END COND	ПОИ	3	3	3	3	4	3				
Ri	WL COMPLIANCE PASS-FA			ASS		ASS		ASS				

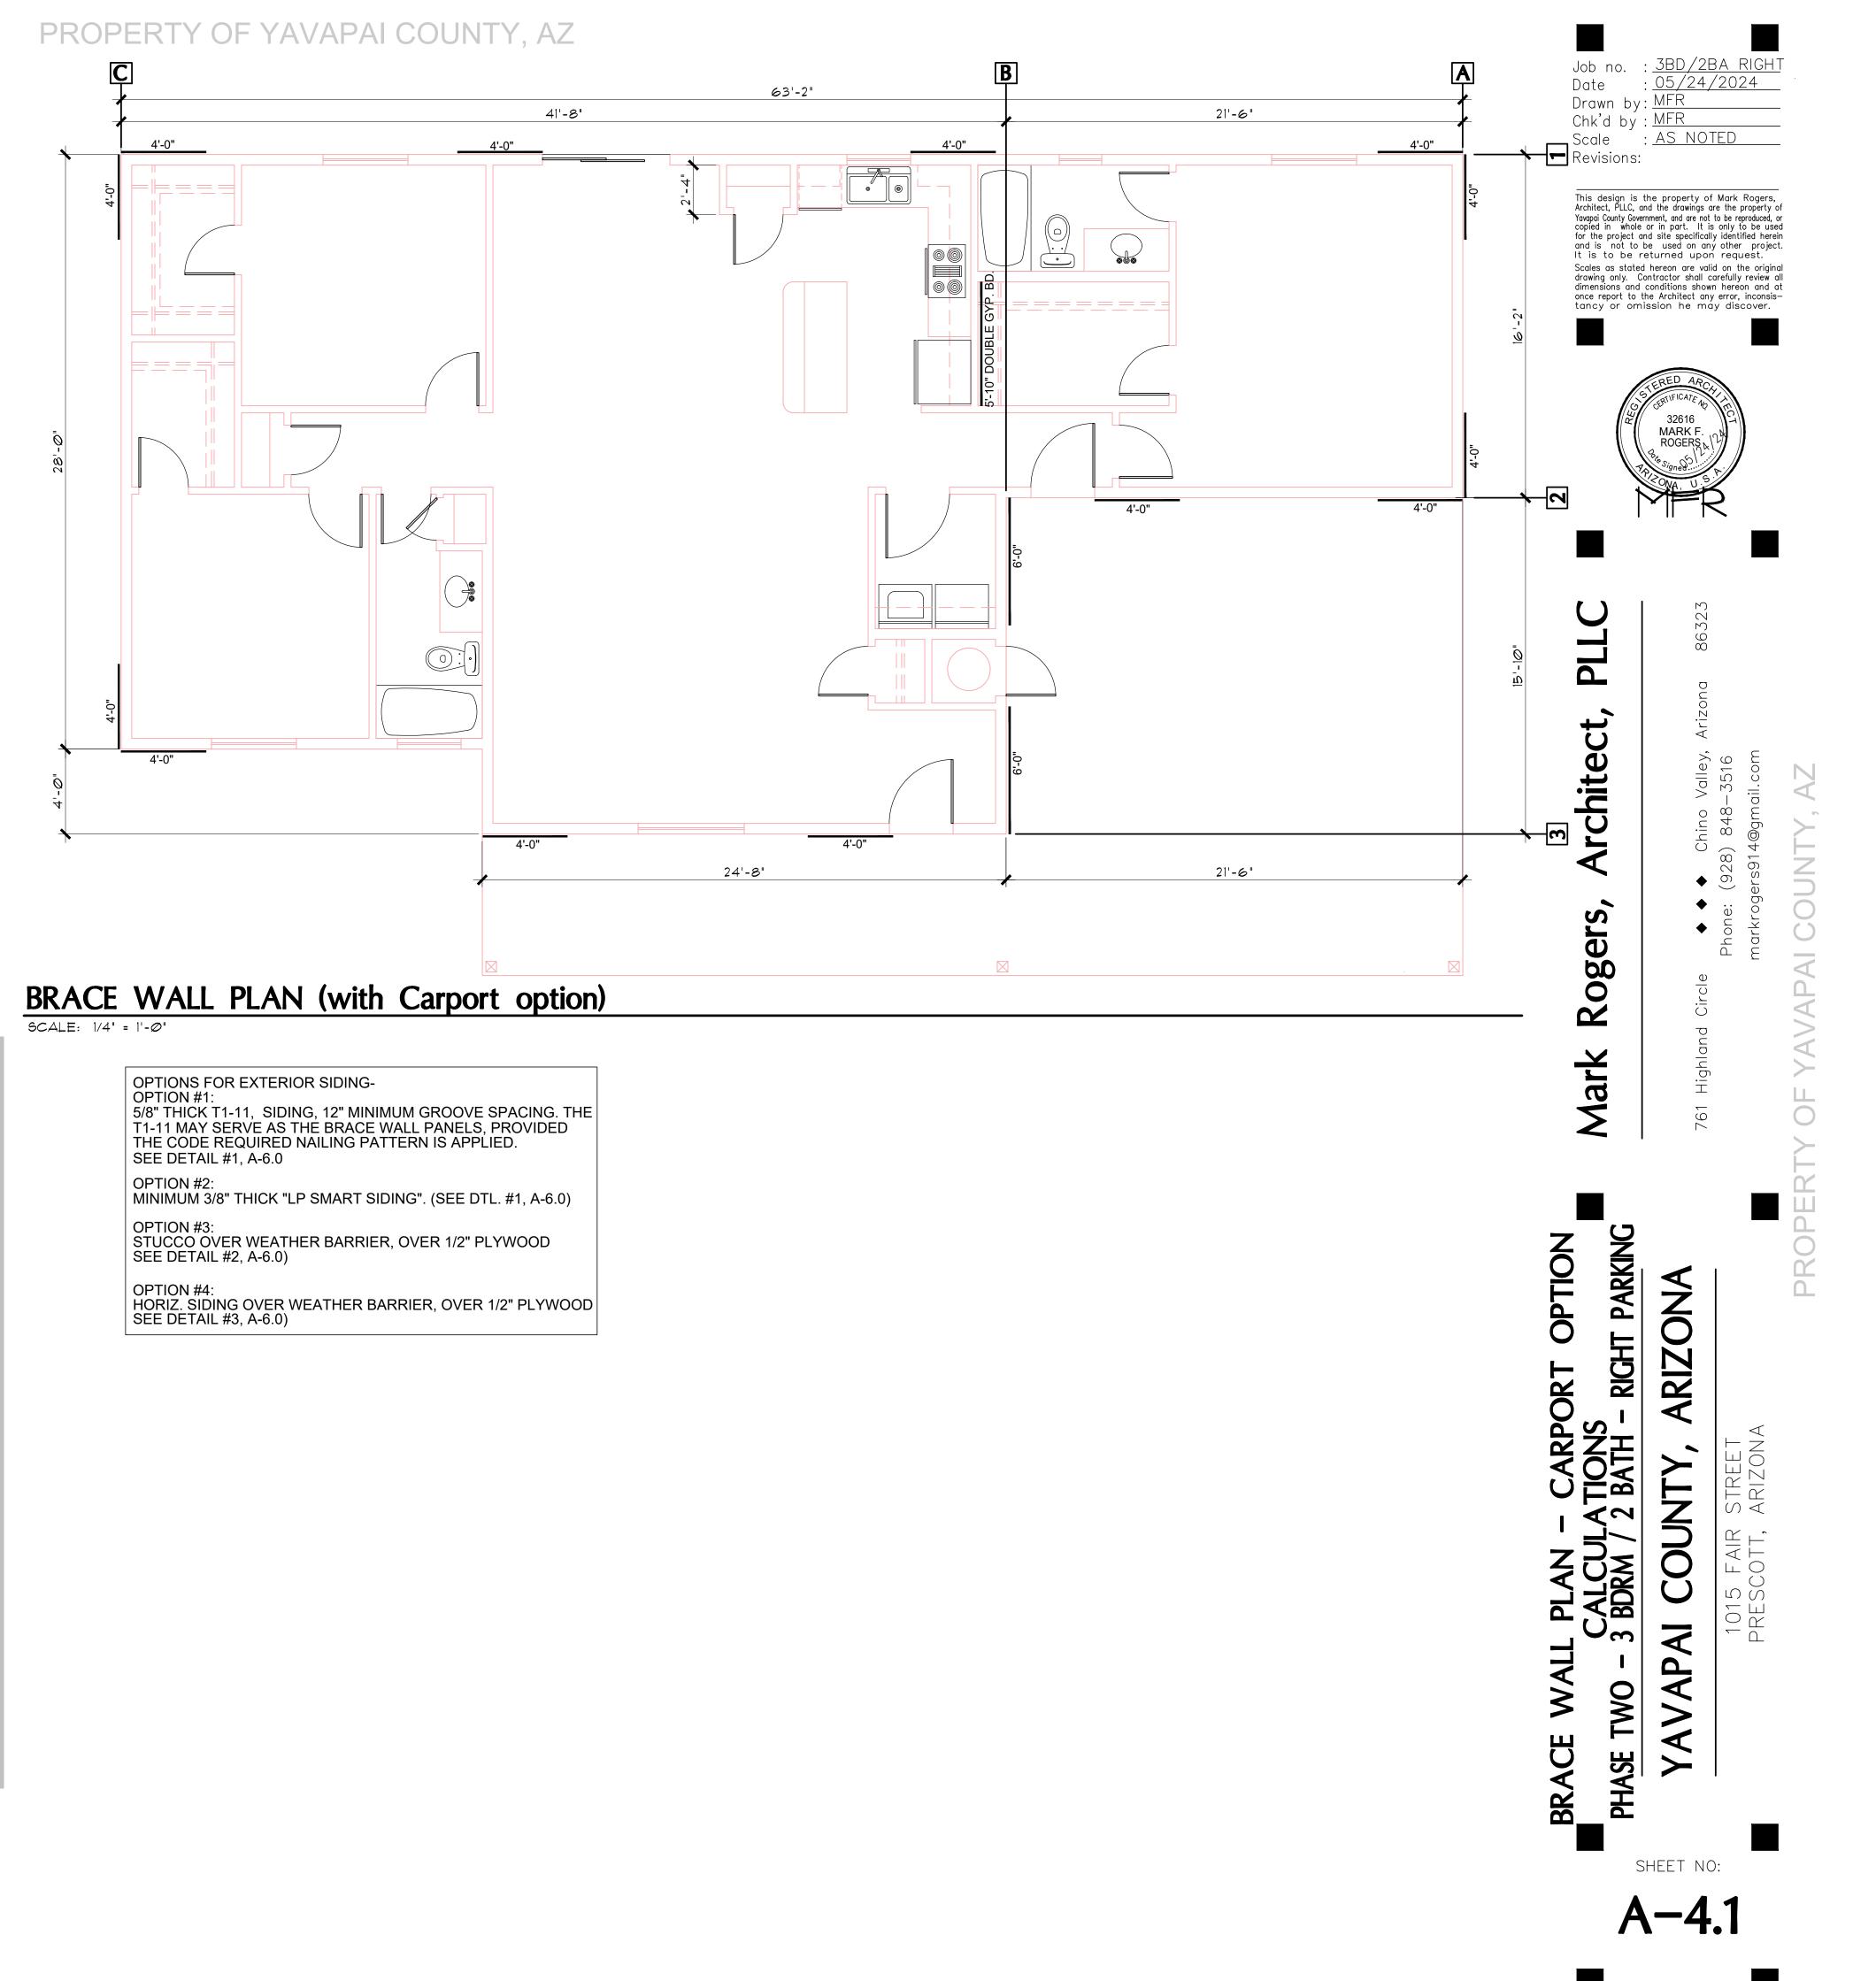

PROPERTY OF YAVAPAI COUNTY. AZ

PROPERTY OF YAVAPAI COUNTY, AZ

STAMPS. IT IS THE RESPONSIBILITY OF THE

OWNER/APPLICANT TO REVIEW AND

ACKNOWLEDGE APPLICABLE STAMPS.

once report to the Architect any error, inconsistancy or omission he may discover.


SECTIONS 2 BATH - RIGHT PARKING

BUILDING - 3 BDRM /


TW0


**PHASE** SHEET NO:

A - 6.0

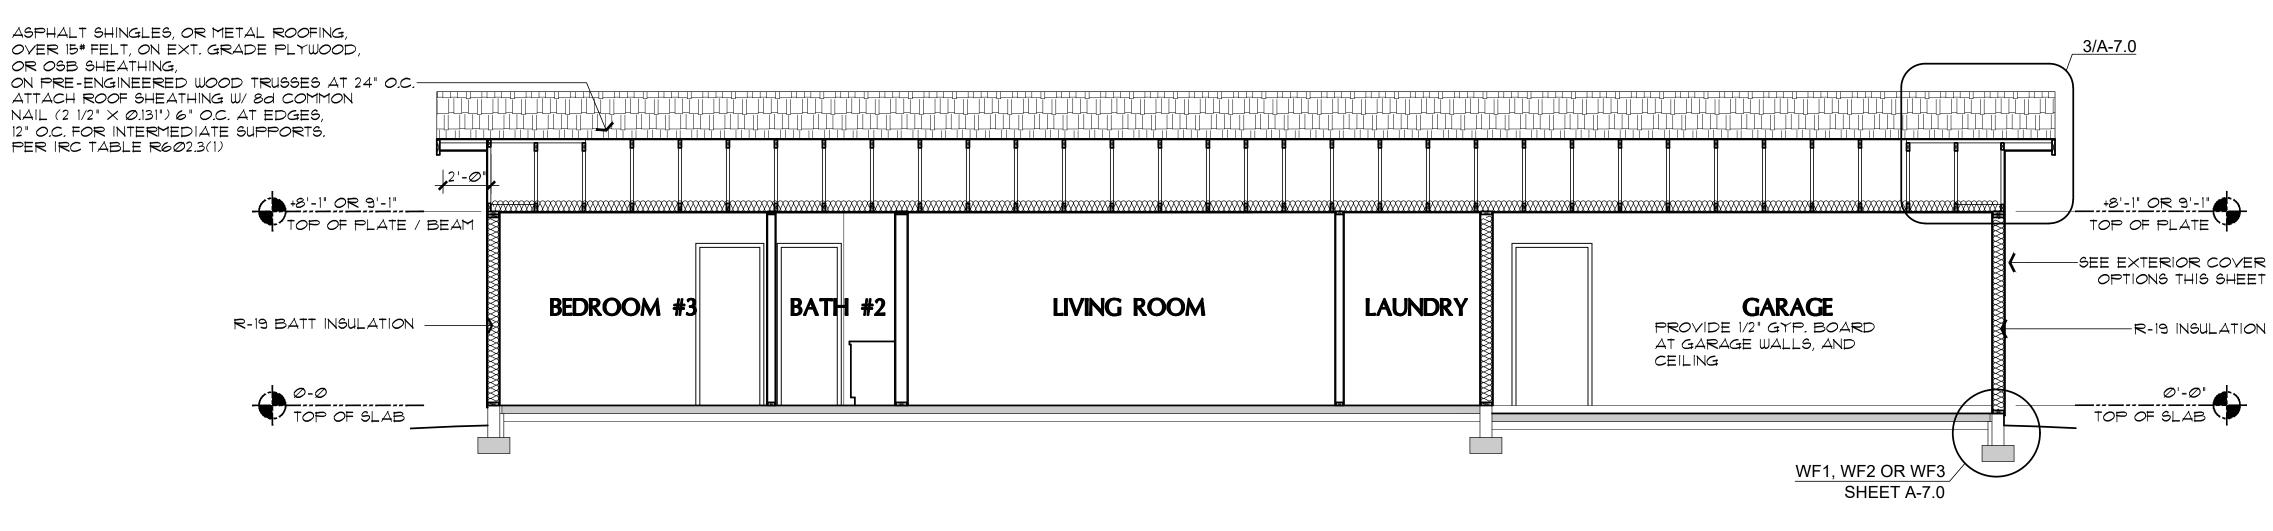


# BUILDING CROSS SECTION SCALE: 1/4" = 1'-0"

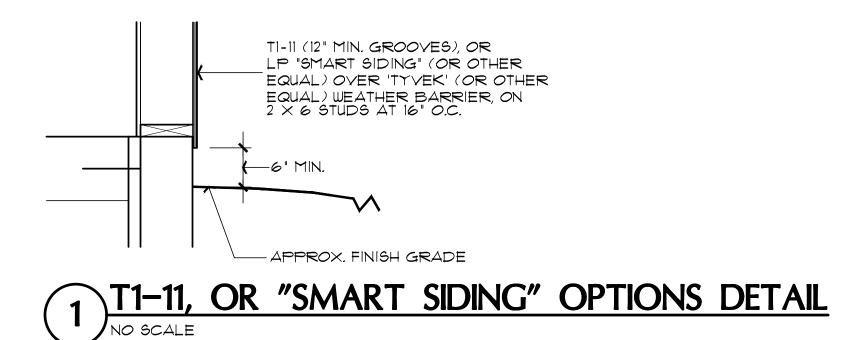

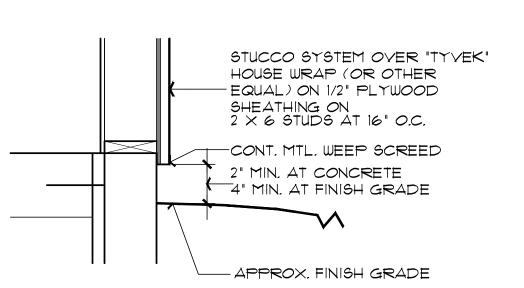




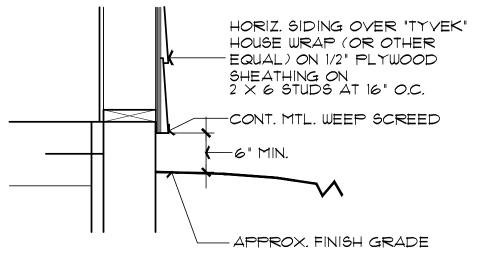

HORIZ. SIDING OPTION DETAIL

NO SCALE

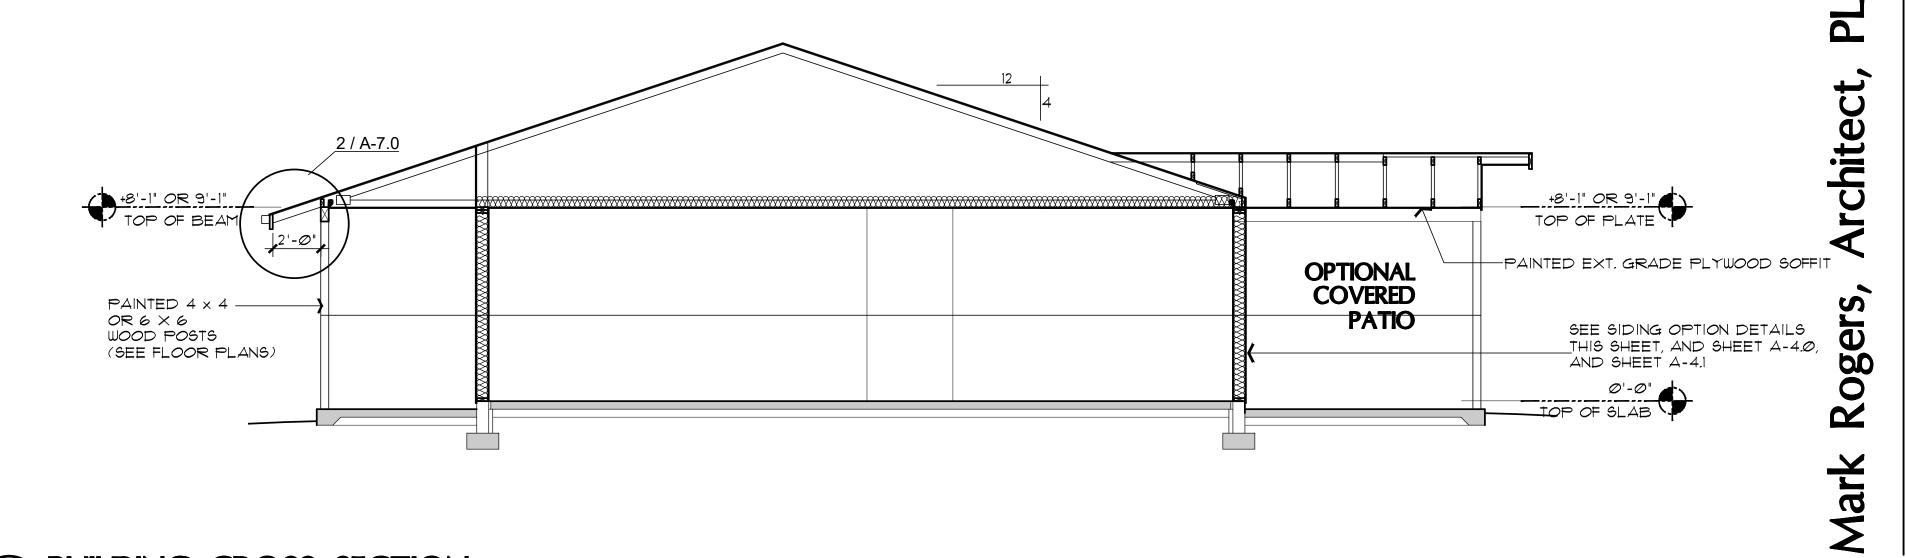

BUILDING CROSS SECTION


SCALE: 1/4" = 1'-0"

WINDOW INSTALLATION

STAMPS. IT IS THE RESPONSIBILITY OF THE

OWNER/APPLICANT TO REVIEW AND


**ACKNOWLEDGE APPLICABLE STAMPS.** 

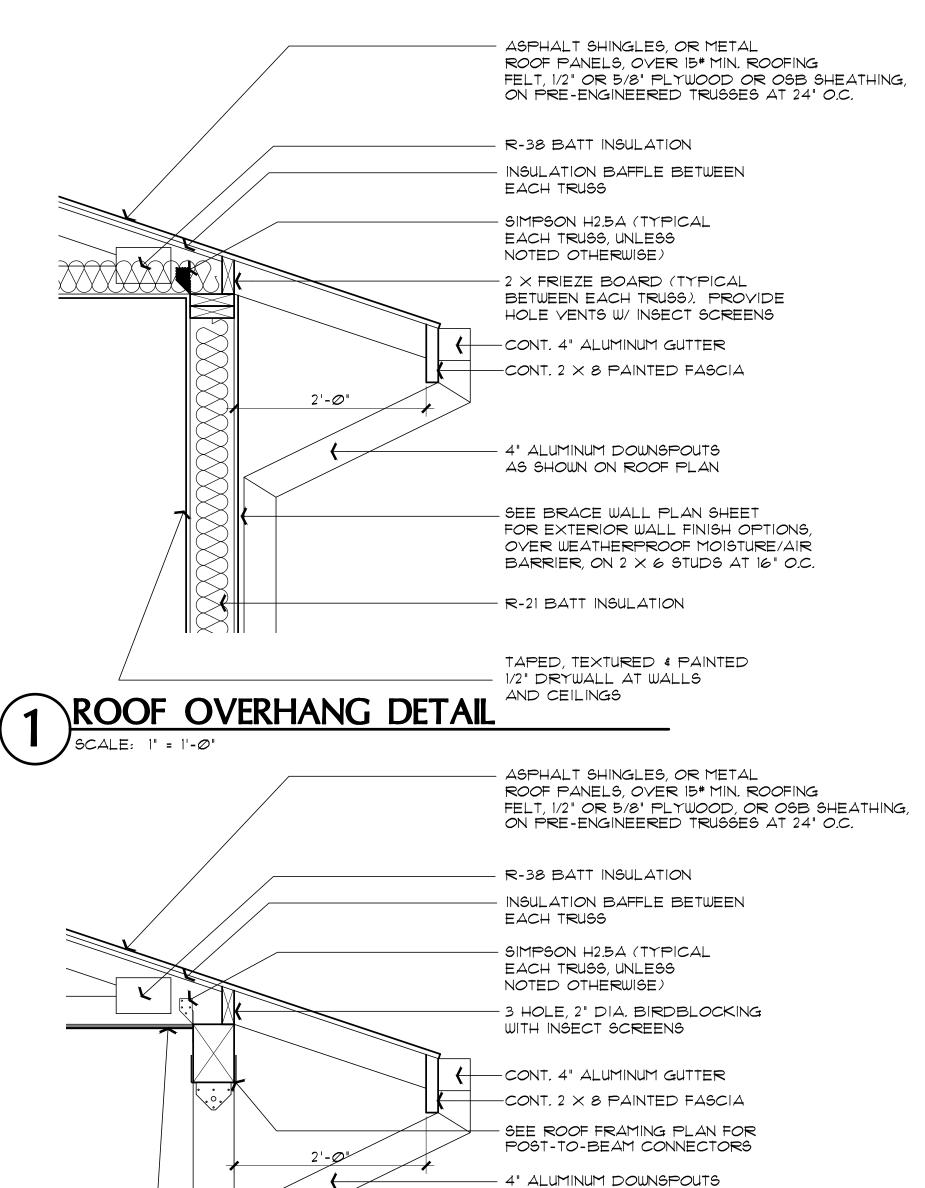


NAIL (2 1/2"  $\times$  Ø.131") 6" O.C. AT EDGES, 12" O.C. FOR INTERMEDIATE SUPPORTS. PER IRC TABLE R602.3(1) ROOF OVERHANG AT BEAM DETAIL


ATTACH ROOF SHEATHING W/ 8d COMMON


# PROPERTY OF YAVAPAI COUNTY, AZ

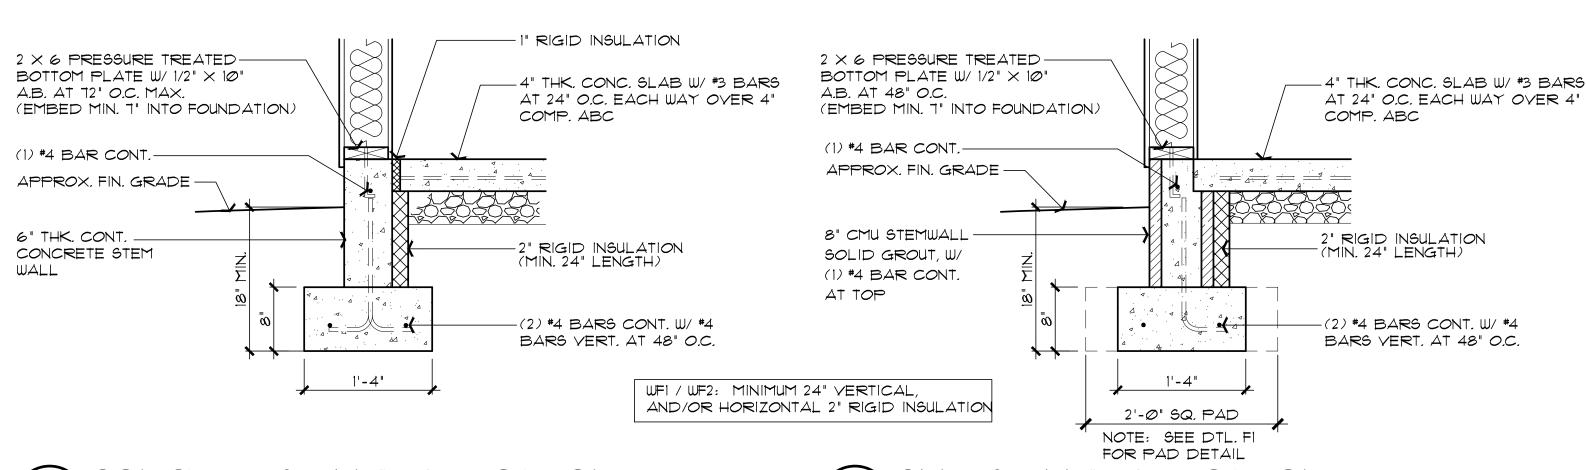


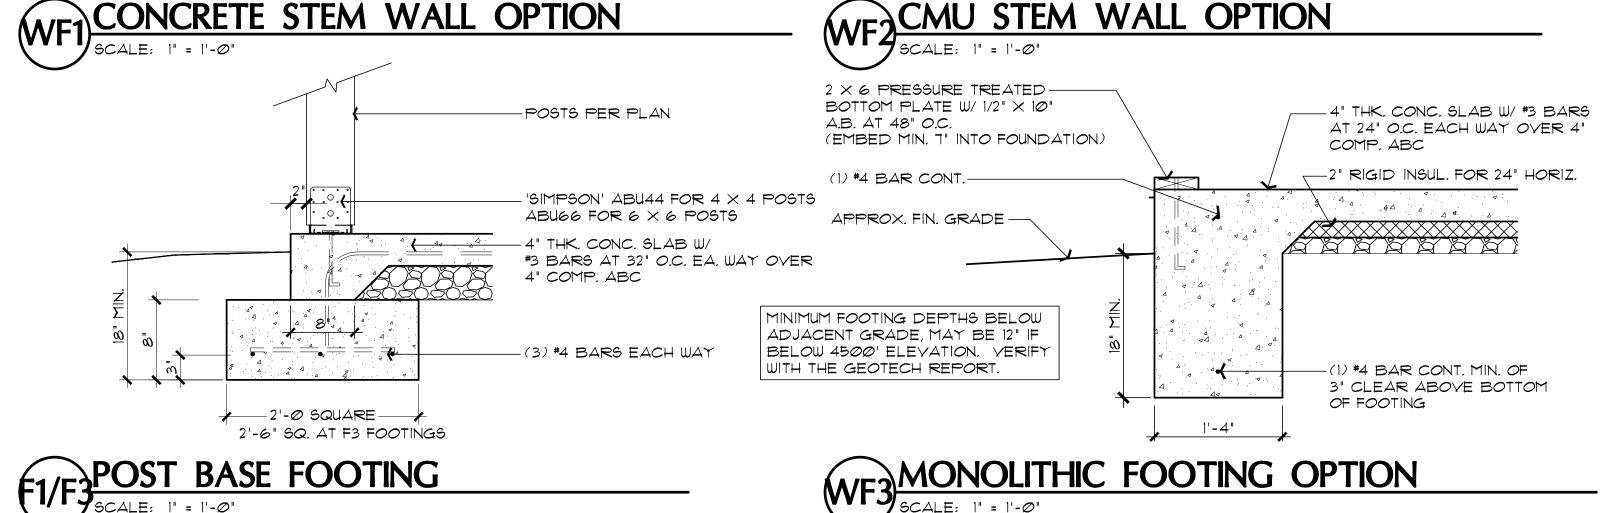

SCALE: 1" = 1'-Ø"

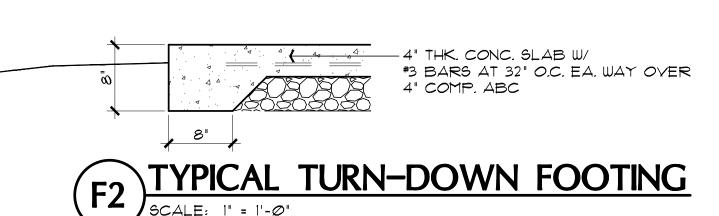

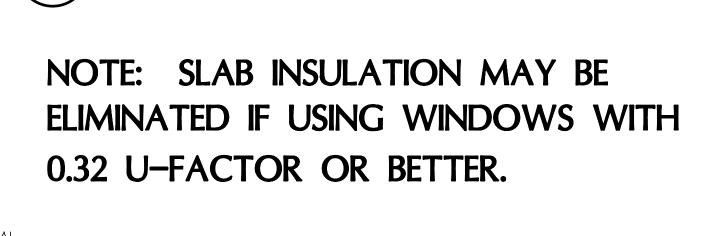

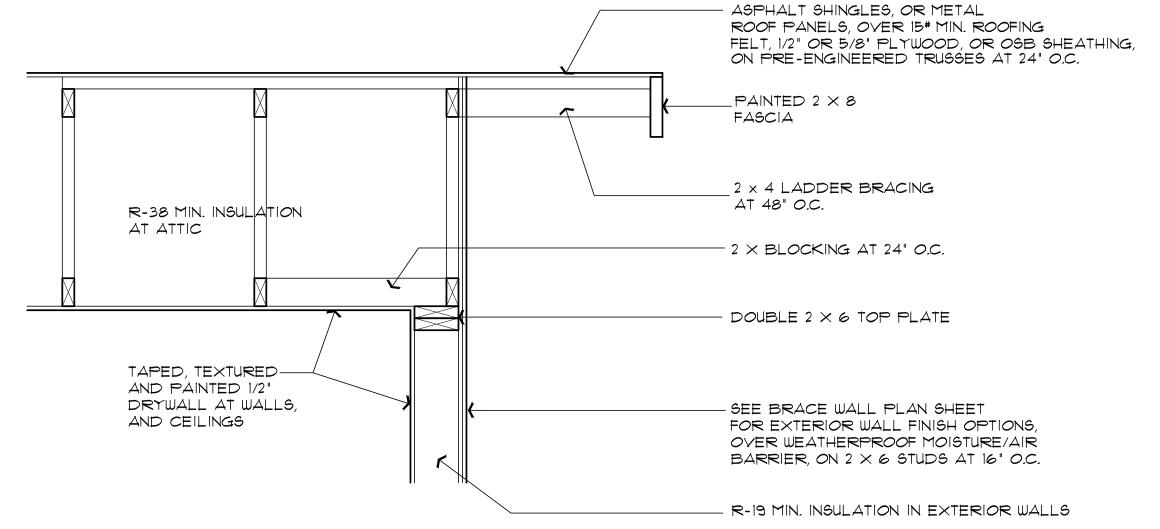


AS SHOWN ON ROOF PLAN

 $_{-}$  4 imes 4 PAINTED WOOD POST


PAINTED 1/2" A/C PLYWOOD

OR OSB

GABLE END-WALL DETAIL

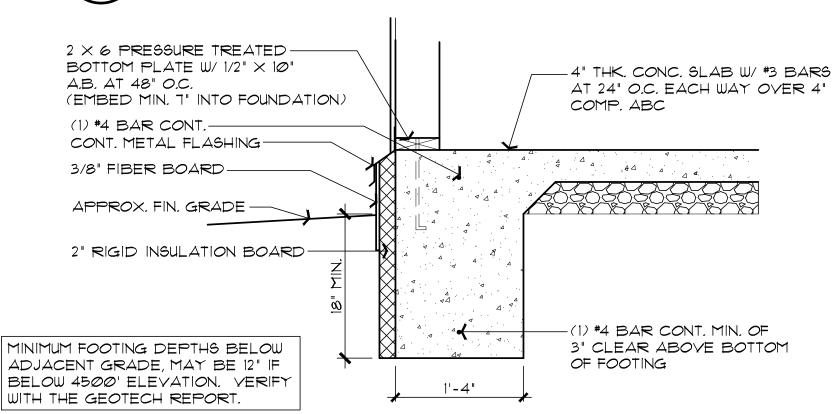



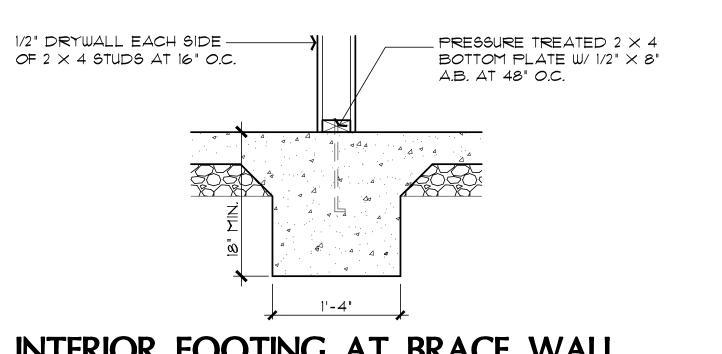

INTERIOR FOOTING AT BRACE WALL

GB METHOD (IRC TABLE R602.10.4)

SCALE 11 - 11-21

AS NOTED Scale Revisions: This design is the property of Mark Rogers, Architect, PLLC, and the drawings are the property of Yavapai County Government, and are not to be reproduced, or copied in whole or in part. It is only to be used for the project and site specifically identified herein and is not to be used on any other project It is to be returned upon request. Scales as stated hereon are valid on the original drawing only. Contractor shall carefully review all once report to the Architect any error, inconsis tancy or omission he may discover. 32616 MARK F. ROGERS N

05/24/2024

MFR

Drawn by

Chk'd by : MFR

Image: Control of the con oger

DETAILS - RIGHT PARKING **ARIZON** 

ROOF 2 BATH PHASE TWO - 3 BDRM

A - 7.0

SHEET NO:

#### 2. CEILINGS

\* CEILING INSULATION TO BE MIN. R-30 (ZONE 2) t R-38 (ZONE 4) MARKERS SHALL BE AFFIXED TO THE TRUSSES OR JOIST AND MARKED WITH THE MIN. ISTALLED THICKNESS BY ONE INCH HIGH NUMBERS. A MIN. OF ONE MARKER SHALL BE INSTALLED FOR EVERY 300 SQ. FT. OF AREA WITH NUMBERS TO FACE THE ATTIC ACCESS OPENING. MARKERS MUST BE INSTALLED AT ROUGH IN OR WALL INSULATION INSPECTIONS.

#### 3. WOOD FRAMED EXTERIOR WALLS (MIN. R-19 FOR 2 X 6 WALLS) \* WALL INSULATION SHALL BE IN SUBSTANTIAL CONTACT WITH THE SURFACE BEING INSULATED TO AVOID AIR PATHS THAT

\* INSULATION SHALL NOT BE COMPRESSED BY INSET STAPLING OF THE BATT INSULATION OR OTHER MEANS \* INSULATION SHALL FILL ALL CAVATIES COMPLETLY BY CUTTING INSULATION AROUND ELECTRCAL OUTLETS AND SWITCHES AND BY SLICING INSULATION TO FIT BEHIND AND IN FRONT OF ELECTRICAL WIRING IN THE CAVITY AND PLUMBING PIPING \* BAND JOISTS AND OTHER INTERSTITIAL FLOOR ELEMENTS OF THE WALL SHALL BE INSULATED

#### 4. NOT USED.

#### 5. BUILDING THERMAL ENVELOPE

BYPASS THE INSULATION.

THE SEALING METHODS BETWEEN DISSIMILAR MATERAILS SHALL ALLOW FOR DIFFERENTAIL EXPANSION AND CONTRACTION. THE FOLLOWING SHALL BE CAULKED, GASKETED WEATHER STRIPPED OR OTHERWISE SEALED WITH AN AIR BARRIER MATERIAL, SUITABLE FILM OR SOLID MATERIAL:

#### A. ALL JOINTS, SEAMS AND PENETRATIONS. B. SITE BUILT WINDOWS, DOORS AND SKYLIGHTS C. OPENINGS BETWEEN WINDO AND DOOR ASSEMBLIES AND

- THEIR RESPECTIVE JAMBS AND FRAMING. D. UTILITY PENETRATIONS.
- E. DROPPED CEILINGS OR CHASES ADJACENT TO THE THERMAL ENVELOPE. F. KNEE WALLS
- G. WALLS AND CEILINGS SEPERATING GARAGE FROM CONDITIONED SPACES. H. BEHIND TUB AND SHOWERS ON EXTERIOR WALLS

I. COMMEN WALLS BETWEEN DWELLING UNITS

J. OTHER SOURCES OF INFILTRATION.

#### 6. FENESTRATION AIR LEAKAGE

\* WINDOW, SKYLIGHT AND SLIDING GLASS DOOR SHALL HAVE AN AIR INFILTRATION RATE OF NO MORE THAN 0.3 CFM PER SQUARE FOOT, AND SINGING DOORS NO MORE THAN 0.5 CFM. SPECIFICATIONS SHALL BE LISTED ON THE MANUF. LABEL. (USE TYVEK HOUSE WRAP, INSTALL PER MANUF. SPECS)

#### 7. RECESSED LIGHTING

RECESSED LUMINAIRES INSTALLED IN THE BUILDING THERMAL ENEVELOPE SHALL BE SEALED TO LIMIT AIR LEAKAGE BETWEEN CONDITIONED AND UNCONDITIONED SPACES BY

A. IC RATED AND LABELED WITH ENCLOSURES THAT ARE SEALED OR GASKETED TO PREVENT AIR LEAKAGE TO CEILING CAVITY OR UNCONDITIONED SPACE OR B. IC RATED AND LABELED AS MEETING ASTM E 283± OR C. LOCATED INSIDE AIRTIGHT SEALED BOX WITH CLEARANCES OF AT LEAST Ø.5 INCH FROM COMBUSTIBLE MATERIAL AND 3 INCHEDS FROM INSULATION.

#### 8. HEAT PUMP SUPPLEMENTARY HEAT

\* HEAT PUMPS HAVING SUPPLEMENTARY ELECTRIC- RESISTANCE HEAT SHALL HAVE CONTROLS THAT, EXCEPT DURING DEFROST PREVENT SUPPLEMENTAL HEAT OPERATION WHTN THE HEAT PUMP COMPRESSOR CAN MEET THE HEATING LOAD.

#### \* AT LEAST ONE THERMOSTAT SHALL BE PROVIDED FOR EACH SEPARATE HEATING & COOLING SYSTEM.

#### 10. DUCT INSULATION

\* SUPPLY AND RETURN DUCTS SHALL BE INSULATED TO A MIN. OF R-8 (EXCEPT DUCTS THAT COMPLETLY INSIDE THE BUILDING THERMAL ENVELOPE.)

\* ALL DUCTS, AIR HANDLERS, FILTER BOXES, AND BUILDING CAVITIES (NOT FOR AIR SUPPLY) USED AS DUCTS SHALL BE SEALED. JOINTS AND SEAMS SHALL COMPLY WITH SECTION M1601.3.1 OF THE IRC.

#### 12. MECHANICAL SYSTEM PIPING INSULATION \* MECHANICAL SYSTEM PIPING CAPABLE OF CARRYING FLUIDS ABOVE 105 D. F OR BELOW 55 D. F SHALL BE INSULATED TO A MIN. OF R-2

#### 13. CIRCULATING HOT WATER SYSTEMS

\* ALL CIRCULATING SERVICE HOT WATER PIPING SHALL BE INSULATED TO AT LEAST R-2. ALL NEW RESIDENCES WITH 2 OR MORE BATHROOMS SHALL HAVE A CIRCULATING HOT WATER SYSTEM. CHWS SHALL INCLUDE AN AUTOMATIC OR READILY ACCESSIBLE MANUAL SWITCH THAT CAN TURN OFF THE HWCP WHEN THE SYSTEM IS NOT IN USE. THERMAL SIPHONING SYSTEMS SHALL HAVE A VALVE TO REDUCE FLOW. ALTERNATE SYSTEM SHALL BE CONSIDERED.

#### 14. MECHANICAL VENTIALTION \*OUTDOOR AIR INTAKES AND EXHAUST SHALL HAVE AUTOMATIC

GRAVITY DAMPER THAT CLOSE WHEN THE VENTILATION SYSTEM IS NOT OPERATING. 15. EQUIPTMENT SIZING

#### \*HEATING & COOLING EQUIPTMENT SHALL BE SIZED IN ACCORDANCE

WITH SECTION M1401.3 OF THE IRC.


#### 16. AIR LEAKAGE

AIR FLOW RETARDERS (HOUSE WRAPS) MUST BE:

A. IMPERMEABLE TO AIR FLOW. B. CONTINOUS OVER THE ENTIRE BUILDING ENVELOPE C. ABLE TO WITHSTAND THE FORCES THAT MAY ACT


ON IT DURING AND AFTER CONSTRUCTION. D. DURABLE OVER THE EXPECTED LIFETIME OF THE BUILDING. E. ALL SEAMS AND EDGES MUST BE SEALED/TAPED PER MANUF SPECIFICATIONS


#### PROPERTY OF YAVAPAI COUNTY, AZ

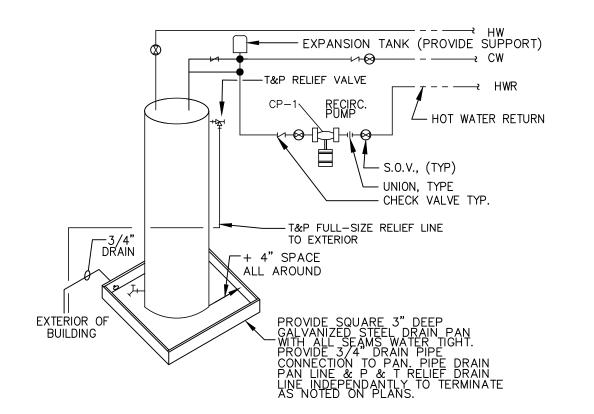


## PROVIDE ACCESSABLE ELECTRICAL DISCONNECT


#### **ELECTRIC WATER HEATER**

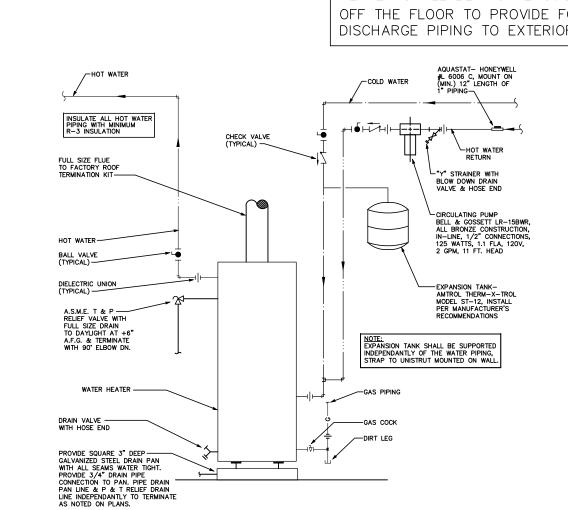

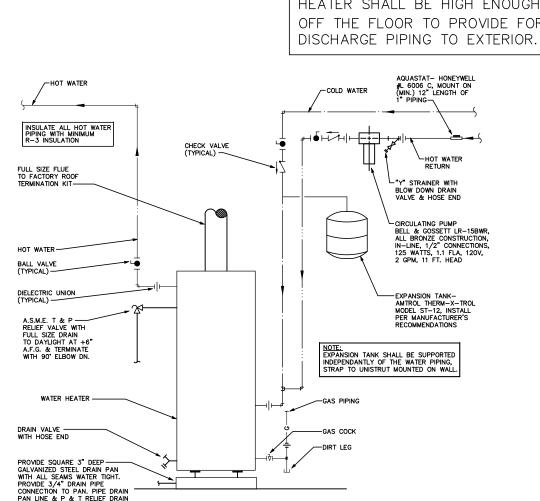

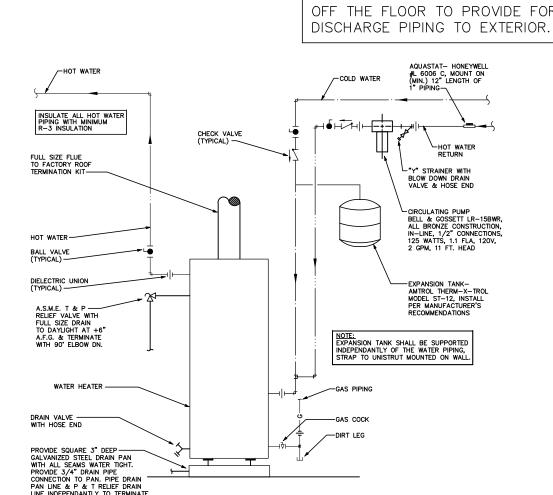


#### NOTE: DRAIN PAN, AND T&P MUST DRAIN BY GRAVITY. WATER HEATER SHALL BE HIGH ENOUGH OFF THE FLOOR TO PROVIDE FOR

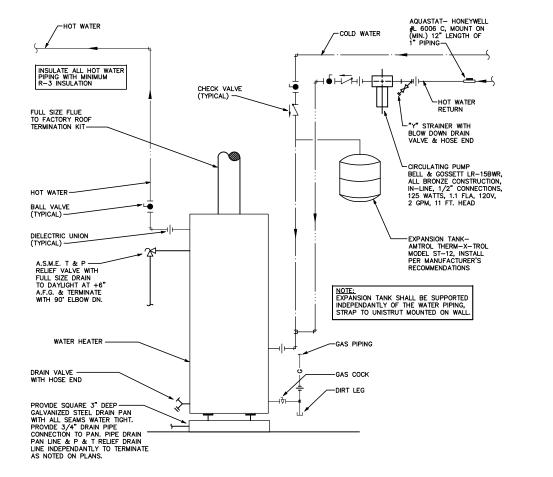

GAS WATER HEATER OPTION NO SCALE


NO SCALE

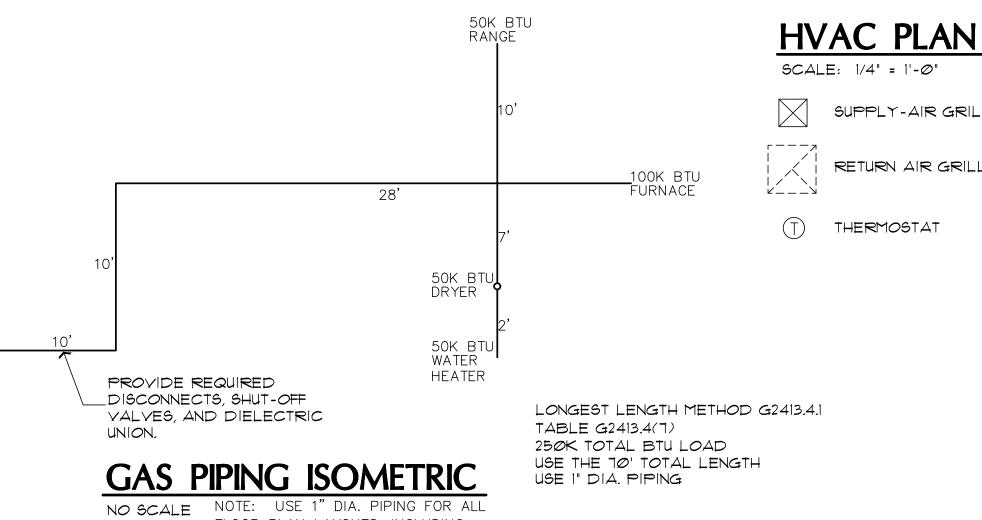

FLOOR PLAN LAYOUTS, INCLUDING. ALTERNATE FIXTURE LOCATIONS. THE PLUMBING CONTRACTOR SHALL

SHALL VERIFY ALL SIZING, AND FITTINGS, PRIOR TO INSTALLATION.

NOTE: EXACT LENGTH FROM EXTERIOR OF STRUCTURE, TO GAS SOURCE, WILL VARY FOR EACH PROJECT.



# PLUMBING FIXTURE CLEARANCES

WATER CLOSETS

21 IN. CLEARANCE

- +

NO SCALE

30 IN. MIN.

24 IN. CLEARANCE IN FRONT OF OPENING

SHOWER

PER IRC FIGURE R3Ø1.1

# HVAC/PLUMBING GENERAL NOTES:

#### 1. THE MECHANICAL CONTRACTOR SHALL DETERMINE THE FINAL EQUIPMENT SIZING, DUCT SIZING, AND DUCT LAYOUT PRIOR TO INSTALLATION. 2. DRAIN AND VENT SIZES TO BE DETERMINED BY PLUMBING CONTRACTOR.

3. WATER HEATER RELIEF YALVE SHALL EXTEND OUTSIDE OF THE BUILDING WITH THE END OF THE PIPE NOT MORE THAN 2' NOR LESS THAN 6" ABOVE THE GROUND AND POINTING DOWNWARD.

#### 4. PROVIDE A PAN, AND DRAIN FOR THE WATER HEATER.

ATTIC

ACCES#

WATER

T & P DRAIN

HEATER

PROVIDE

GRILLE

CEILING R/A

5. THE CLOTHES DRYER EXHAUST DUCT SHALL BE AT LEAST THE DIAMETER OF THE APPLIANCE OUTLET AS RECOMMENDED BY THE MANUFACTURER AND SHALL TERMINATE AT THE EXTERIOR OF THE BUILDING. IT SHALL NOT EXCEED 25' IN LENGTH WITH REDUCTIONS FOR BENDS. THE DUCT SHALL TERMINATE NOT LESS THAN 3' FROM A PROPERTY LINE.

#### 6. THE SITE PLAN SHALL INDICATE THE LOCATION OF THE GAS SOURCE THE DISTANCE AND PIPE SIZE FROM THE SOURCE, TO THE RESIDENCE, AND THE TYPE OF FUEL (NATURAL GAS OR PROPANE).

1. BI-FOLD DOOR AT WATER HEATER CLOSET SHALL BE LOUVERED FOR COMBUSTION AIR (MIN. REQUIREMENTS OF 100 SQ. INCHES OF FREE AIR).

AS NOTED Scale Revisions: This design is the property of Mark Rogers, Architect, PLLC, and the drawings are the property of Yavapai County Government, and are not to be reproduced, or copied in whole or in part. It is only to be used for the project and site specifically identified herein and is not to be used on any other project It is to be returned upon request. Scales as stated hereon are valid on the original drawing only. Contractor shall carefully review all dimensions and conditions shown hereon and at once report to the Architect any error, inconsistancy or omission he may discover.

MFR

<u>05/24/2024</u>

Date

Drawn by

Chk'd by:



A/C

COMP.

4

ar

**PARKIN** 

**B**/

Jm

S

-LAN ENERG WO -

area)

ve habitable / DETAILS ATH - RIGHT |

Ve

**E** 

84

RIZ

4

SHEET NO:

M-1.0

2. CEILINGS

4. NOT USED.

Date

COMP)

FAU LOCATION

HVAC/PLUMBING GENERAL NOTES:

4. PROVIDE A PAN, AND DRAIN FOR THE WATER HEATER.

AND THE TYPE OF FUEL (NATURAL GAS OR PROPANE).

THE GROUND AND POINTING DOWNWARD.

LESS THAN 3' FROM A PROPERTY LINE.

1. THE MECHANICAL CONTRACTOR SHALL DETERMINE THE FINAL EQUIPMENT SIZING, DUCT SIZING, AND DUCT LAYOUT PRIOR TO INSTALLATION.

2. DRAIN AND VENT SIZES TO BE DETERMINED BY PLUMBING CONTRACTOR.

3. WATER HEATER RELIEF YALVE SHALL EXTEND OUTSIDE OF THE BUILDING

5. THE CLOTHES DRYER EXHAUST DUCT SHALL BE AT LEAST THE DIAMETER

6. THE SITE PLAN SHALL INDICATE THE LOCATION OF THE GAS SOURCE

1. BI-FOLD DOOR AT WATER HEATER CLOSET SHALL BE LOUVERED FOR

COMBUSTION AIR (MIN. REQUIREMENTS OF 100 SQ. INCHES OF FREE AIR).

THE DISTANCE AND PIPE SIZE FROM THE SOURCE, TO THE RESIDENCE,

OF THE APPLIANCE OUTLET AS RECOMMENDED BY THE MANUFACTURER AND

SHALL TERMINATE AT THE EXTERIOR OF THE BUILDING. IT SHALL NOT EXCEED

25' IN LENGTH WITH REDUCTIONS FOR BENDS. THE DUCT SHALL TERMINATE NOT

WITH THE END OF THE PIPE NOT MORE THAN 2' NOR LESS THAN 6" ABOVE

ACCES\$

HEATER

IN ATTIC

൧

ar

**PARKING** 

arport)

4

**M** 

Ġ, ap **E** ENER WO-

arage/C ETAILS - RIGHT

RIZ

S


SHEET NO:

M-1.1

THE EXPANSION TANK (PROVIDE SUPPORT) T&P RELIEF VALVE — HOT WATER RETURN - UNION, TYPE CHECK VALVE TYP. - T&P FULL-SIZE RELIEF LINE / 3/4" DRAIN TO EXTERIOR ┌─+ 4" SPACE ALL AROUND EXTERIOR OF TO TERMINATE

# PROVIDE ACCESSABLE ELECTRICAL DISCONNECT

# **ELECTRIC WATER HEATER**

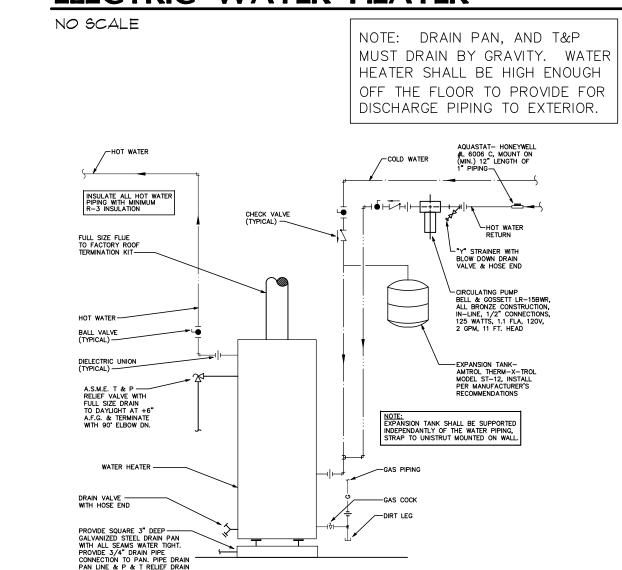

GAS WATER HEATER OPTION

50K BTU **RANGE** 

DRYER

50K B1

WATER

HEATER

100K BTU

FURNACE

LONGEST LENGTH METHOD G2413.4.1

TABLE G2413.4(7)

5. BUILDING THERMAL ENVELOPE THE SEALING METHODS BETWEEN DISSIMILAR MATERAILS SHALL ALLOW FOR DIFFERENTAIL EXPANSION AND CONTRACTION. THE FOLLOWING SHALL BE CAULKED, GASKETED WEATHER STRIPPED OR OTHERWISE SEALED WITH AN AIR BARRIER MATERIAL, SUITABLE FILM OR SOLID MATERIAL:

MALL REMAIN ON WINDOWS, SKYLIGHTS & DOORS

UNTIL INSPECTED AND APPROVED FOR THE ABOVE REQUIREMENT.

THE FOUNDATION SLAB INSULATION MAY BE ELIMINATED IF

\* CEILING INSULATION TO BE MIN. R-30 (ZONE 2) t R-38 (ZONE 4)

MARKED WITH THE MIN. ISTALLED THICKNESS BY ONE INCH

FOR EVERY 300 SQ. FT. OF AREA WITH NUMBERS TO FACE

AT ROUGH IN OR WALL INSULATION INSPECTIONS.

OF THE BATT INSULATION OR OTHER MEANS

OF THE WALL SHALL BE INSULATED

3. WOOD FRAMED EXTERIOR WALLS (MIN. R-19 FOR 2 X 6 WALLS) \* WALL INSULATION SHALL BE IN SUBSTANTIAL CONTACT WITH THE SURFACE BEING INSULATED TO AVOID AIR PATHS THAT

MARKERS SHALL BE AFFIXED TO THE TRUSSES OR JOIST AND

HIGH NUMBERS. A MIN. OF ONE MARKER SHALL BE INSTALLED

THE ATTIC ACCESS OPENING. MARKERS MUST BE INSTALLED

\* INSULATION SHALL NOT BE COMPRESSED BY INSET STAPLING

\* INSULATION SHALL FILL ALL CAVATIES COMPLETLY BY CUTTING

INSULATION AROUND ELECTRCAL OUTLETS AND SWITCHES AND

BY SLICING INSULATION TO FIT BEHIND AND IN FRONT OF ELECTRICAL WIRING IN THE CAVITY AND PLUMBING PIPING \* BAND JOISTS AND OTHER INTERSTITIAL FLOOR ELEMENTS

USING A MAX. Ø.32 U-FACTOR ON GLAZING.

A. ALL JOINTS, SEAMS AND PENETRATIONS. B. SITE BUILT WINDOWS, DOORS AND SKYLIGHTS C. OPENINGS BETWEEN WINDO AND DOOR ASSEMBLIES AND THEIR RESPECTIVE JAMBS AND FRAMING. D. UTILITY PENETRATIONS.

E. DROPPED CEILINGS OR CHASES ADJACENT TO THE THERMAL ENVELOPE. F. KNEE WALLS G. WALLS AND CEILINGS SEPERATING GARAGE FROM CONDITIONED SPACES. H. BEHIND TUB AND SHOWERS ON EXTERIOR WALLS

I. COMMEN WALLS BETWEEN DWELLING UNITS

J. OTHER SOURCES OF INFILTRATION.

6. FENESTRATION AIR LEAKAGE

BYPASS THE INSULATION.

\* WINDOW, SKYLIGHT AND SLIDING GLASS DOOR SHALL HAVE AN AIR INFILTRATION RATE OF NO MORE THAN 0.3 CFM PER SQUARE FOOT, AND SINGING DOORS NO MORE THAN 0.5 CFM. SPECIFICATIONS SHALL BE LISTED ON THE MANUF. LABEL (USE TYVEK HOUSE WRAP, INSTALL PER MANUF. SPECS)

7. RECESSED LIGHTING RECESSED LUMINAIRES INSTALLED IN THE BUILDING THERMAL ENEVELOPE SHALL BE SEALED TO LIMIT AIR LEAKAGE BETWEEN CONDITIONED AND UNCONDITIONED SPACES BY

A. IC RATED AND LABELED WITH ENCLOSURES THAT ARE SEALED OR GASKETED TO PREVENT AIR LEAKAGE TO CEILING CAVITY OR UNCONDITIONED SPACE OR B. IC RATED AND LABELED AS MEETING ASTM E 283± OR C. LOCATED INSIDE AIRTIGHT SEALED BOX WITH CLEARANCES OF AT LEAST Ø.5 INCH FROM COMBUSTIBLE MATERIAL AND

3 INCHEDS FROM INSULATION.

8. HEAT PUMP SUPPLEMENTARY HEAT \* HEAT PUMPS HAVING SUPPLEMENTARY ELECTRIC- RESISTANCE HEAT SHALL HAVE CONTROLS THAT, EXCEPT DURING DEFROST PREVENT SUPPLEMENTAL HEAT OPERATION WHIN THE HEAT PUMP COMPRESSOR CAN MEET THE HEATING LOAD.

\* AT LEAST ONE THERMOSTAT SHALL BE PROVIDED FOR EACH SEPARATE HEATING & COOLING SYSTEM.

10. DUCT INSULATION

\* SUPPLY AND RETURN DUCTS SHALL BE INSULATED TO A MIN. OF R-8 (EXCEPT DUCTS THAT COMPLETLY INSIDE THE BUILDING THERMAL ENVELOPE.)

\* ALL DUCTS, AIR HANDLERS, FILTER BOXES, AND BUILDING CAVITIES (NOT FOR AIR SUPPLY) USED AS DUCTS SHALL BE SEALED. JOINTS AND SEAMS SHALL COMPLY WITH SECTION

M1601.3.1 OF THE IRC. 12. MECHANICAL SYSTEM PIPING INSULATION \* MECHANICAL SYSTEM PIPING CAPABLE OF CARRYING FLUIDS ABOVE 105 D. F OR BELOW 55 D. F SHALL BE INSULATED TO

#### A MIN. OF R-2

13. CIRCULATING HOT WATER SYSTEMS \* ALL CIRCULATING SERVICE HOT WATER PIPING SHALL BE INSULATED TO AT LEAST R-2. ALL NEW RESIDENCES WITH 2 OR MORE BATHROOMS SHALL HAVE A CIRCULATING HOT WATER SYSTEM. CHWS SHALL INCLUDE AN AUTOMATIC OR READILY ACCESSIBLE MANUAL SWITCH THAT CAN TURN OFF THE HWCP WHEN THE SYSTEM IS NOT IN USE. THERMAL SIPHONING SYSTEMS SHALL HAVE A VALVE TO REDUCE FLOW.

14. MECHANICAL VENTIALTION \*OUTDOOR AIR INTAKES AND EXHAUST SHALL HAVE AUTOMATIC GRAVITY DAMPER THAT CLOSE WHEN THE VENTILATION SYSTEM

ALTERNATE SYSTEM SHALL BE CONSIDERED.

15. EQUIPTMENT SIZING

IS NOT OPERATING.

\*HEATING & COOLING EQUIPTMENT SHALL BE SIZED IN ACCORDANCE WITH SECTION M1401.3 OF THE IRC.

16. AIR LEAKAGE

A. IMPERMEABLE TO AIR FLOW. B. CONTINOUS OVER THE ENTIRE BUILDING ENVELOPE C. ABLE TO WITHSTAND THE FORCES THAT MAY ACT ON IT DURING AND AFTER CONSTRUCTION.

SHALL VERIFY ALL SIZING, AND FITTINGS, PRIOR TO INSTALLATION.

#### 250K TOTAL BTU LOAD USE THE 70' TOTAL LENGTH GAS PIPING ISOMETRIC USE 1" DIA, PIPING

PROVIDE REQUIRED

\_DISCONNECTS, SHUT-OFF

VALVES, AND DIELECTRIC

NOTE: USE 1" DIA. PIPING FOR ALL FLOOR PLAN LAYOUTS, INCLUDING. ALTERNATE FIXTURE LOCATIONS. THE PLUMBING CONTRACTOR SHALL

NOTE: EXACT LENGTH FROM EXTERIOR OF STRUCTURE, TO GAS SOURCE, WILL VARY FOR EACH PROJECT.

# HVAC PLAN (with Carport option)

SCALE: 1/4" = 1'-0" SUPPLY-AIR GRILL

RETURN AIR GRILL THERMOSTAT

O 30 IN. 30 IN. MIN. 24 IN. CLEARANCE IN FRONT OF OPENING

SHOWER

PER IRC FIGURE R3Ø1.

CEILING R/A


GRILLE

PLUMBING FIXTURE CLEARANCES NO SCALE

AIR FLOW RETARDERS (HOUSE WRAPS) MUST BE:

D. DURABLE OVER THE EXPECTED LIFETIME OF THE BUILDING. E. ALL SEAMS AND EDGES MUST BE SEALED/TAPED PER MANUF SPECIFICATIONS


SEE ATTACHED COVER SHEET FOR ALL STAMPS. IT IS THE RESPONSIBILITY OF THE OWNER/APPLICANT TO REVIEW AND ACKNOWLEDGE APPLICABLE STAMPS.

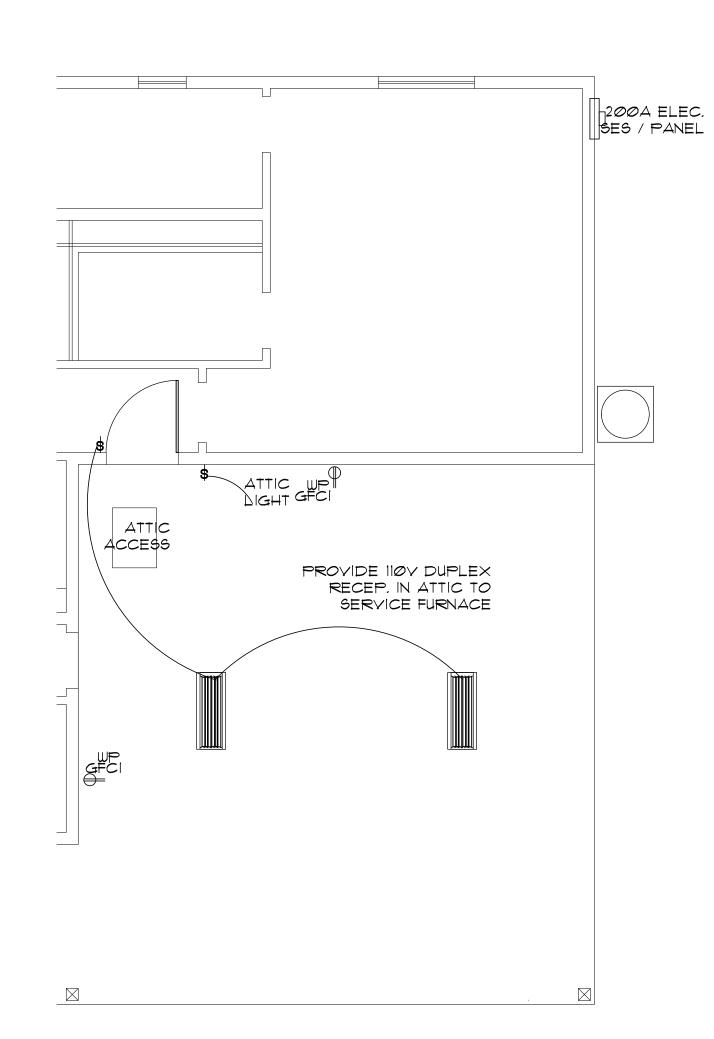

# PARTIAL ELECTRICAL PLAN (with Carport option)

ELECTRICAL PLAN (with Garage option)

ELECTRICAL SYMBOLS ELECTRICAL GENERAL NOTES

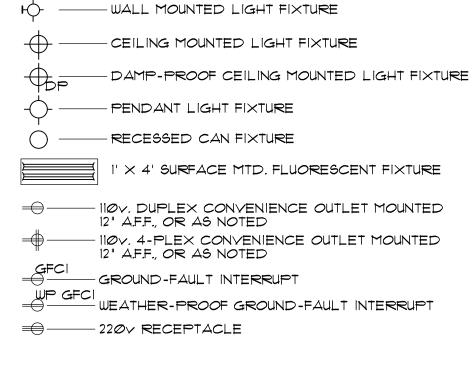

- \$ SINGLE POLE SWITCH MOUNTED
  AT 48" OR AS NOTED

  \$ 3-WAY SINGLE POLE SWITCH MOUNTED
  AT 48" OR AS NOTED

  CEILING EXHAUST FAN
- S —— SMOKE DETECTOR


  S/OM —— SMOKE DETECTOR / CARBON MONOXIDE COMBO
- CEILING FAN W/ LIGHT KIT

------CABLE TY OUTLET

• — DOORBELL BUTTON

■ — TELEPHONE OUTLET

- 1. ALL WORKMANSHIP, MATERIALS, AND METHODS SHALL CONFORM TO N.E.C.- 2017 EDITION.
- 2. ALL HABITABLE ROOMS SHALL BE PROVIDED W/ ELECTRICAL OUTLETS SO THAT NO PART OF THE WALL IS MORE THAN 6' FROM AN OUTLET. WALL SECTIONS 2' OR LARGER & KITCHEN COUNTERS WIDER THAN 12" SHALL BE SERVICED BY A RECEPTACLE.
- 3. ALL RECEPTICALS IN BATHROOMS, OUTSIDE & WITHIN 6' OF WATER SOURCE SHALL BE G.F.C.I.
- 4. ALL SMOKE DETECTORS SHALL BE INTERCONNECTED ON SEPARATE
  CIRCUIT & SHALL RECEIVE PRIMARY POWER FROM BUILDING WIRING &
  SHALL HAVE BATTERY BACKUP. CONNECT NEW SMOKE DETECTORS TO
  NEW AUDIBLE SYSTEM INSIDE EXISTING RESIDENCE.
- 5. LIGHTS IN CLOSETS SHALL BE 18" FROM SHELVING (MEASURED HORZTL. OR BE RECESSED.
- 6. PROVIDE MINIMUM TWO 20A BRANCH CIRCUITS FOR RECEPTACLES LOCATED IN THE KITCHEN, PANTRY, EATING AREA, A SEPARATE 20A BRANCH CIRCUIT TO THE LAUNDRY EQUIP., AND A SEPARATE 20A BRANCH CIRCUIT FOR BATHROOM RECEPTACLES.
- 1. ALL BRANCH CIRCUITS THAT SUPPLY 120-VOLT SINGLE PHASE 15 & 20 AMP OUTLETS INSTALLED IN FAMILY ROOMS, DINING ROOMS LIVING ROOMS, PARLORS, LIBRARIES, DENS, BEDROOMS, SUNROOMS RECREATION ROOMS, CLOSETS, HALLWAYS AND SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY COMBINATION TYPE ARC FAULT CURCUIT INTERUPTERS INSTALLED TO PROVIDE PROTECTION OF THE
- 8. FIXTURES, FITTINGS, BOXES AND RECEPTACLES LOCATED IN DAMP OR WET LOCATIONS SHALL BE 'LISTED' TO BE SUITABLE FOR SUCH CONDITIONS.
- 9. CONTRACTOR TO EMBED 20' OF \*4 AWG COPPER WIRE IN FOOTING FOR ELECTRICAL SERVICE GROUND. PROVIDE BONDING TO THE INTERIOR WATER PIPING AND ABOVE GROUND PORTION OF GAS PIPING SYSTEM.
- 10. IN KITCHEN AND DINING ROOMS A RECEPTACLE OUTLET SHALL BE INSTALLED AT EACH WALL COUNTER SPACE 12" OR WIDER SO THAT AT NO POINT ALONG THE WALL IS MORE THAN 24" FROM A RECEPTACLE OUTLET AND SHALL BE GFCI PROTECTED.
- 11. PROVIDE AT LEAST ONE WEATHER PROOF RECEPTACLE OUTLET NOT MORE THAN 6'-6" ABOVE GRADE AND GFCI PROTECTED. AT THE FRONT AND BACK OF EACH DWELLING, ALL RECEPTACLES INSTALLED OUTDOORS MUST BE GFCI PROTECTED.
- 12. ALL EXTERIOR LIGHTING SHALL CONFORM TO YAVAPAI COUNTY DARK SKY ORDINANCE.
- 13. IN ATTICS, A SERVICE OUTLET & LIGHTING FIXTURE LOCATED NEAR THE APPLIANCE REQUIRING SERVICE SHALL BE CONTROLLED BY A SWITCH AT THE ENTRY OF THE ATTIC. (REQUIRED FOR ATTIC MOUNT FURNACES)

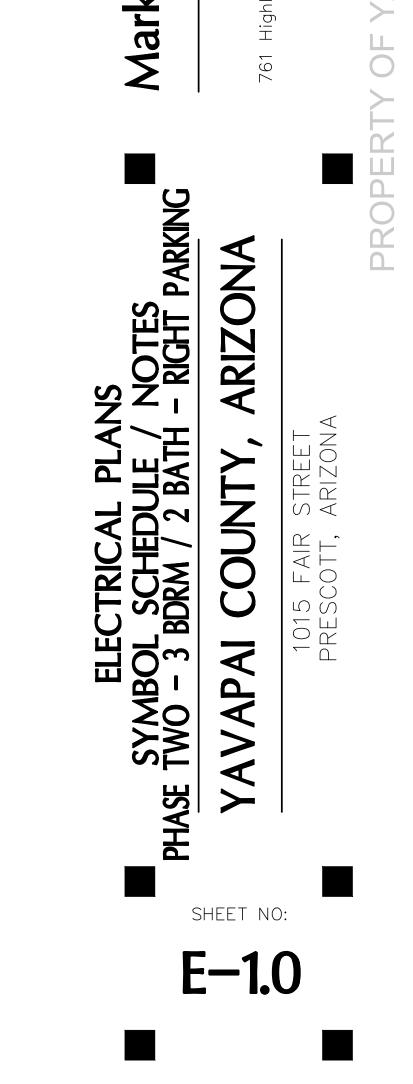

Drawn by

Revisions:

ogers,

AS NOTED

This design is the property of Mark Rogers, Architect, PLLC, and the drawings are the property of

Yavapai County Government, and are not to be reproduced, or copied in whole or in part. It is only to be used for the project and site specifically identified herein and is not to be used on any other project. It is to be returned upon request.

Scales as stated hereon are valid on the original drawing only. Contractor shall carefully review all

once report to the Architect any error, inconsistancy or omission he may discover.

MARK F.

Scale

PROPERTY OF YAVAPAI COUNTY, AZ